

NISTIR 7301

Proposed Test Methodology and Performance Rating Standard for Residential Fuel Cell Systems

Mark W. Davis
Michael W. Ellis
Brian P. Dougherty



National Institute of Standards and Technology
Technology Administration, U.S. Department of Commerce

NISTIR 7301

Proposed Test Methodology and Performance Rating Standard for Residential Fuel Cell Systems

Mark W. Davis

Brian P. Dougherty

*Building Environment Division
Building and Fire Research Laboratory*

Michael W. Ellis

*Department of Mechanical Engineering
Virginia Polytechnic Institute and State University*

June 2006



U.S. Department of Commerce

Carlos M. Gutierrez, Secretary

Technology Administration

Robert Cresanti, Under Secretary of Commerce for Technology

National Institute of Standards and Technology

William Jeffrey, Director

Executive Summary

A test method and rating standard is proposed for residential fuel cell systems (RFCSs). The proposed approach extends previously developed test procedures for fuel cells by establishing specific test methods and calculation procedures that are applicable to *residential* fuel cell systems. These methods and procedures provide the end user with metrics that can be used to evaluate the merit of a RFCS in a particular application.

In the proposed standard, RFCSs are classified into four types: Type I – Grid independent, electrical load following; Type II – Grid interconnected, constant power; Type III – Grid interconnected, thermal load following; and Type IV – Grid interconnected, water heating. Test procedures are described that yield simplified models for the performance of each system based on appropriate load characteristics and ambient conditions.

For Type I systems, the steady fuel use, thermal energy output, and water use are expressed as functions of the electrical part-load ratio and the ambient temperature. In addition, the thermal energy output, electrical output, fuel use, and water use (for RFCS humidification) associated with a hot water simulated use test are evaluated as functions of electrical part-load ratio and ambient temperature. Transient electrical load factors are measured and applied to the thermal energy output and the fuel consumption to incorporate the system's performance under transient electrical loads.

For Type II systems, electrical power remains constant and the steady fuel use, thermal energy output, and water use are expressed as functions of ambient temperature. In addition, the thermal energy output, electrical output, fuel use, and water use (for RFCS humidification) associated with a hot water simulated use test are evaluated at rated power and specific values of ambient temperature.

For Type III systems, the system output follows the thermal load and the steady fuel use, electrical output, and water use are expressed as functions of thermal part-load ratio and ambient temperature. In addition, the electrical output, fuel use, and water use (for RFCS humidification) associated with a hot water simulated use test are evaluated at specific values of ambient temperature.

For Type IV systems, the system operates to meet the hot water requirement and the thermal energy output, electrical output, fuel use, and water use (for RFCS humidification) associated with a hot water simulated use test are evaluated at specific values of ambient temperature.

For each system type, steady and simulated use models are combined to predict the performance of the system in response to typical residential electrical and thermal loads for various representative climates. For units that draw ventilation air from the indoors, the performance is corrected to account for the energy required to condition outdoor air to replace the ventilation air. The annual performance is expressed in terms of the impact on the end user's net electricity use (or generation), fuel use, and water use.

Table of Contents

EXECUTIVE SUMMARY.....	<i>i</i>
TABLE OF CONTENTS.....	<i>ii</i>
1. PURPOSE	<i>1</i>
2. SCOPE.....	<i>1</i>
2.1 General.....	1
2.2 Interaction with residential energy systems.....	1
2.3 Location of installation	1
3. DEFINITIONS AND NOMENCLATURE.....	<i>2</i>
3.1 Definitions.....	2
3.2 Nomenclature	2
4. CLASSIFICATION	<i>8</i>
4.1 Type I: Grid independent, electrical load following RFCS	8
4.2 Type II: Grid interconnected, constant power RFCS.....	8
4.3 Type III: Grid interconnected, thermal load following RFCS.....	8
4.4 Type IV: Grid interconnected, RFCS for water heating	8
5. INSTRUMENTS AND DATA ACQUISITION SYSTEMS.....	<i>8</i>
5.1 Instruments and Methods of Measurement.....	8
5.2 Permissible variation in controls and uncertainty limits in measured values	9
6. APPARATUS	<i>9</i>
6.1 General.....	9
6.2 Description of Test Apparatus	10
6.2.1 Overview.....	10
6.2.2 Environmental chamber.....	10
6.2.3 Fuel supply and monitoring system	10
6.2.4 Power interface and monitoring system.....	11
6.2.5 Thermal interface and monitoring system	11
6.2.6 Power to auxiliary devices	12
6.2.7 Exhaust gas monitoring.....	12
7. METHODS OF TEST	<i>12</i>
7.1 Required tests by fuel cell type.....	12
7.1.1 Simulated-use test	12
7.1.2 Steady-state test	13
7.1.3 Transient electrical power test.....	13
7.2 Environmental conditions for testing.....	13
8. TEST PROCEDURES.....	<i>14</i>
8.1 Hot water simulated-use test.....	14
8.1.1 Operating conditions.....	14
8.1.2 Initialization	14
8.1.3 Water heating simulated-use test procedure	14
8.1.4 Test results	15
8.2 Steady-state test	15
8.2.1 Operating conditions.....	15

8.2.2	Initialization	15
8.2.3	Test results	16
8.3	Transient electrical power test	16
8.3.1	Operating conditions	16
8.3.2	Initialization and test procedure	16
8.3.3	Test results	16
8.4	Data acquisition	17
8.5	Safety	18
9.	<i>DATA ANALYSIS</i>	19
9.1	General description	19
9.2	Calculation of Mass and Energy Flow Rates	19
9.2.1	Fuel use rate	19
9.2.2	Net electrical power	19
9.2.3	Steady-state thermal output rate	20
9.2.4	Simulated-use thermal output rate	20
9.2.5	Thermal loss rate	20
9.2.6	Ventilation airflow rate	21
9.2.7	Water use	22
9.3	Transient Electrical Load Factors	23
10.	<i>CALCULATION OF SYSTEM PERFORMANCE RATINGS</i>	25
10.1	General Description	25
10.2	Rated and annual performance for grid independent, electrical load following Type I RFCS	26
10.2.1	Rated performance for outdoor Type I RFCS	26
10.2.2	Rated performance for indoor Type I RFCS	26
10.2.3	Part-load performance evaluation for a Type I RFCS	27
10.2.4	Analysis of Simulated Use Data for Type I RFCS	31
10.2.5	Annual Performance Rating Procedure for Type I RFCS	33
10.3	Rated and annual performance for grid interconnected, constant power Type II RFCS	37
10.3.1	Rated performance for outdoor Type II RFCS	37
10.3.2	Rated performance for indoor Type II RFCS	37
10.3.3	Fuel use, thermal output, ventilation airflow, and water use rates as functions of ambient temperature for Type II RFCS	37
10.3.4	Analysis of Simulated Use Data for Type II RFCS	39
10.3.5	Annual Performance Rating Procedure	40
10.4	Rated and annual performance for grid interconnected, thermal load following Type III RFCS	44
10.4.1	Rated performance for outdoor Type III RFCS	44
10.4.2	Rated performance for Type III RFCS	44
10.4.3	Fuel use, thermal output, ventilation airflow, and water use rates as functions of thermal output and ambient temperature for Type III RFCS	44
10.4.4	Analysis of Simulated Use Data for Type III RFCS	48
10.4.5	Annual Performance Rating Procedure for Type III RFCS	51
10.5	Rated and annual performance for grid interconnected, water heating only Type IV RFCS	57
10.5.1	Rated performance for outdoor Type IV RFCS	57

10.5.2	Rated performance for Type IV RFCS	57
10.5.3	Analysis of Simulated Use Data for Type IV RFCS	57
10.5.4	Annual Performance Rating Procedure for Type IV RFCS.....	60
11.	REFERENCES.....	63
APPENDICES.....		A-1
A. RESIDENTIAL LOADS AND CLIMATE DATA FOR DEPARTMENT OF ENERGY (DOE) CLIMATE REGIONS.....		A-1
B. EXAMPLE CALCULATION.....		B-1
B.1	General Description	B-1
B.2	Nominal performance of a thermal load following RFCS (Type III).....	B-2
B.3	Part-Load Functions.....	B-2
B.4	Simulated Use Data.....	B-4
B.5	Energy Ratings.....	B-5

1. Purpose

Fuel cells are emerging as one of the most promising technologies for meeting the nation's energy needs. Fuel cells can provide both electricity and thermal energy and can offer the benefits of combined heat and power systems at sizes compatible with residential applications.

Residential fuel cell systems (RFCSSs) are currently under development by a number of manufacturers and in a variety of system configurations. As these systems approach commercialization, it is essential that codes, standards, and rating methodologies be developed to support the safe adoption of the technology and to help prospective owners evaluate the benefits of a relatively complex system.

Currently, the American Society of Mechanical Engineers (ASME), American National Standards Institute (ANSI), National Fire Protection Association (NFPA), and other standards organizations are developing standards applicable to a wide range of fuel cells and applications. The ANSI [1] and NFPA [2] standards address the safe operation, construction, installation, and acceptable performance of fuel cell units in general. The ASME standard [3] defines a test procedure for determining the steady performance of a fuel cell system at a single operating point.

The procedure proposed here provides a method of test and a rating methodology to capture the performance of a fuel cell system operating in a residential application [4]. The procedure determines the performance of the RFCS in a series of steady and simulated-use tests. Results from the tests are used to predict the useful electrical and thermal energy supplied by the fuel cell system as well as the fuel used by the system as it interacts with the energy needs of a typical residence in a specified geographic location. Information provided by the rating procedure will help the prospective owner assess the economic value of the fuel cell system for a specific application.

2. Scope

2.1 General

The test methodology and performance rating standard applies to packaged residential fuel cell systems fueled by natural gas, propane, or methanol. Packaged systems include fuel reformers, air compressors, humidifiers, power conditioners, heat rejection devices, heat exchangers for heat delivery systems, condensers, and all other necessary devices and controls to operate as a stand-alone system.

2.2 Interaction with residential energy systems

The standard applies to systems that receive natural gas and supply alternating current electricity to the residence and/or the utility grid. If thermal energy is provided to the residence, it is supplied by a circulating thermal energy delivery circuit.

2.3 Location of installation

The standard applies to systems intended for both indoor and outdoor installation.

3. Definitions and Nomenclature

3.1 Definitions

Circulating fluid – mixture of anti-freeze (specified here to be propylene glycol) and water that circulates between the RFCS and external heat exchangers and that is used to transfer thermal energy from the RFCS to an external load.

Constant power RFCS – a residential fuel cell system that supplies power at a constant rate regardless of the electrical or thermal loads of the residence.

Electrical load following RFCS – a residential fuel cell system that is designed to vary its electrical output in response to the changing electrical energy needs of the residence.

Grid independent RFCS – a residential fuel cell system that incorporates power management systems and/or electrical storage systems to meet the transient residential electrical loads so that interconnection with the utility grid is not necessary.

Grid interconnected RFCS – a residential fuel cell system that must be connected to the utility grid. Grid interconnected systems must meet all applicable codes for interconnection with the utility grid.

Residential fuel cell system (RFCS) – a packaged system that includes a fuel reformer, air compressor, humidifiers, power conditioner, heat rejection devices, heat exchangers for heat delivery systems, and all other necessary devices and controls to operate as a stand-alone system. Residential fuel cell systems receive a hydrocarbon fuel and supply alternating current electricity to a residence. In addition, thermal energy may be supplied to the residence and excess electricity may be supplied the utility grid.

Domestic hot water simulated-use test – a test in which water is withdrawn in specified quantities and at specified times from the preheat tank connected to the RFCS. The draws are scheduled in accordance with a standard procedure and designed to simulate a residential hot water use pattern.

Steady-state test – a test in which the operating conditions including ambient conditions, fuel supply, and energy loads remain constant for the duration of the test.

Thermal load following RFCS – a residential fuel cell system that is designed to vary its thermal output in response to the changing thermal energy needs of the residence.

Real power - time average of the instantaneous product of voltage and current.

3.2 Nomenclature

AE	annual net electrical energy supplied by the RFCS to the residence, kW·h (Btu)
AF	annual natural gas usage by the RFCS, kW·h (Btu)
AG	annual net electrical energy supplied by the RFCS to the utility grid, kW·h
AQ _{wh}	annual thermal energy supplied by the RFCS for water heating, kW·h (Btu)
AQ _{sh}	annual thermal energy supplied by the RFCS for space heating, kW·h (Btu)
AW	annual domestic water usage by the RFCS, L (gal)
c _h	the specific heat of the heat transfer fluid used to transfer thermal energy from the RFCS to an external load, evaluated at the average of the RFCS inlet and outlet temperatures, kJ/kg·°C (Btu/lb _m ·°F)

c_c	the specific heat of water evaluated at the average of the cold water inlet and preheat tank outlet temperatures, kJ/kg·°C (Btu/lb _m ·°F)
\dot{E}^R	power at rating conditions (for an <i>outdoor</i> unit), kW
\dot{E}^{R*}	power at rating conditions (for an <i>indoor</i> unit), kW
\dot{E}_{fc}	net electrical power supplied by the RFCS after deducting power to external auxiliary devices, kW
\dot{E}_{fc}^*	net electrical power supplied by the RFCS after deducting power to external auxiliary devices (for indoor units), kW
\dot{E}_{in}	electrical power supplied to RFCS, kW
\dot{E}_{out}	electrical power supplied by the RFCS, kW
\dot{E}_{aux}	electrical power supplied to auxiliary devices not powered by the RFCS, kW
E_i	net electrical energy supplied to the residence during hour i, kW·h
E_{li}	first approximation to the net electrical energy supplied to the residence during hour i, kW·h
$E_{L,i}$	electrical energy requirement of the residence during hour i, kW·h
$E_{wh,i}$	electrical energy provided by the RFCS as a result of meeting the water heating load during hour i at ambient temperature T_i , kW·h
$E_{wh,i}^*$	electrical energy provided by the RFCS as a result of meeting the water heating load during hour i at ambient temperature T_l , kW·h
$E_{whH,i}$	electrical energy provided by the RFCS as a result of meeting the water heating load during hour i at ambient temperature T_H , kW·h
$E_{whL,i}$	electrical energy provided by the RFCS as a result of meeting the water heating load during hour i at ambient temperature T_L , kW·h
\dot{F}	rate at which fuel energy is used by the RFCS, kW (Btu/h)
\dot{F}^R	rate at which fuel energy is used by the RFCS at rated conditions (for an <i>outdoor</i> unit), kW (Btu/h)
\dot{F}^{R*}	rate at which fuel energy is used by the RFCS at rated conditions (for an <i>indoor</i> unit), kW (Btu/h)
F_i	fuel used during hour i, kW·h (Btu)
\dot{F}_{ss}	the average rate of fuel use by the RFCS during the steady state test, kW (Btu/h)
$F_{wh,i}$	fuel used by the RFCS as a result of meeting the water heating load during hour i at ambient temperature T_i (for an <i>outdoor</i> unit), kW·h (Btu)
$F_{wh,i}^*$	fuel used by the RFCS as a result of meeting the water heating load during hour i at ambient temperature T_l (for an <i>indoor</i> unit), kW·h (Btu)
$F_{whH,i}$	the fuel used by the RFCS as a result of meeting the water heating load during hour i at ambient temperature T_H , kW·h (Btu)

$F_{whL,i}$	fuel used by the RFCS as a result of meeting the water heating load during hour i at ambient temperature T_L , kW·h (Btu)
G_i	electrical energy supplied to the utility grid during hour i , kW·h
HHV_f^0	higher heating value of fuel gas at standard conditions (T^0 ; P^0), kJ/L (Btu/ft ³)
i	index for hours
K_{tf}	transient electrical load correction factor for the fuel use
K_{tq}	transient electrical load correction factor for the thermal output
M_{fuel}	the molar mass of the fuel
\dot{m}_a^{R*}	mass flow rate of ventilation air at rating conditions (for an <i>indoor unit that uses indoor air for ventilation</i>), kg/h (lb _m /h)
\dot{m}_a^{on}	mass flow rate of air to the fuel cell while fuel is reacting, kg/h (lb _m /h)
\dot{m}_a^{off}	mass flow rate of air to the fuel cell while the fuel is not reacting (e.g., during pre- and post-purge periods), kg/h (lb _m /h)
$m_{a,i}^*$	total ventilation air flow quantity (associated with electrical output, space heating, and/or water heating) for hour i , kg (lb _m)
p_a	absolute pressure of air surrounding the RFCS, kPa (psia)
p_f	absolute pressure of fuel gas at the flow rate monitoring point, kPa (psia)
$p_s(T)$	the saturation pressure of water at T , kPa (psia)
p_v	pressure of the exhaust gas at the flow rate monitoring point, kPa-absolute (psia)
p^0	is standard pressure, 101.3 kPa (14.7 psia)
\dot{Q}_{wh}	the useful thermal energy provided for water heating by the RFCS in combination with the specified preheat tank during the simulated use test (i.e. the useful thermal energy delivered by the preheat tank to the water heater tank), kW (Btu/h)
$Q_{fc,i}$	the thermal energy provided by the fuel cell for water heating and space heating during hour i , kW·h (Btu)
\dot{Q}_{fc}	thermal output rate from the RFCS, kW (Btu/h)
$\dot{Q}_{fc,ss}$	the average thermal output by the RFCS during the steady state test, kW (Btu/h)
$Q_{loss,i}$	the thermal energy lost in the circulating fluid between the RFCS and the preheat tank during hour i , kW·h (Btu)
$Q_{wh,i}$	the thermal energy provided for water heating during hour i , kW·h (Btu)
\dot{Q}^R	thermal output rate at rated conditions (for an <i>outdoor</i> unit), kW (Btu/h)
\dot{Q}^{R*}	thermal output rate at rated conditions (for an <i>indoor</i> unit), kW (Btu/h)
r_{af}	mass basis air-to-fuel ratio
r_e	average electrical part-load ratio – the ratio of the electrical output during an hour to the <i>rated</i> electrical output for an hour
r_{1e}	first approximation to the average electrical part-load ratio

r_t	average thermal part-load ratio - the ratio of the thermal output during an hour to the <i>rated</i> thermal output for an hour
RH_a	relative humidity of the ambient air, %
RH_v	relative humidity of the exhaust air from the RFCS, %
T_a	temperature of air surrounding the RFCS, °C (°F)
T_{ci}	temperature of cold water entering the preheat tank, °C (°F)
T_f	absolute temperature of fuel gas at the flow rate monitoring point, K (R)
T_{he}	temperature of circulating fluid at the exit from the RFCS, °C (°F)
T_{hi}	temperature of circulating fluid at the inlet to the RFCS, °C (°F)
T_p	temperature of water in preheat tank, °C (°F)
T_{pe}	temperature of water leaving the preheat tank, °C (°F)
T_v	absolute temperature of the exhaust gas at the point where the flow rate is measured, K (R)
T^0	standard temperature, 298 K (537 R)
τ	duration of the steady state test, hours
\dot{V}_c	volumetric flow of cold water into the preheat tank, L/s (ft ³ /h.)
\dot{V}_f	volumetric flow rate of fuel gas, L/h (ft ³ /h)
\dot{V}_h	volumetric flow rate of the heat transfer fluid through the RFCS, L/s (ft ³ /h)
\dot{V}_v	the volumetric flow rate of the exhaust gas, L/h (ft ³ /h)
\dot{V}_w	flow rate of domestic water to the fuel cell (i.e. to supply the humidification system), L/h (gal/h)
\dot{V}_w^R	water use rate at rated conditions (for an <i>outdoor</i> unit), L/h (gal/h)
\dot{V}_w^{R*}	water use rate at rated conditions (for an <i>indoor</i> unit), L/h (gal/h)
$V_{w,i}$	total volume of water used (associated with electrical output, space heating, and/or water heating for an <i>outdoor</i> unit) for hour i , L (gal)
$V_{w,i}^*$	total volume of water used (associated with electrical output, space heating, and/or water heating for an <i>indoor</i> unit) for hour i , L (gal)
$V_{w,wh,i}$	water used by the RFCS as a result of meeting the water heating load during hour i at ambient temperature T_i (for an <i>outdoor</i> unit), L (gal)
$V_{w,wh,i}^*$	water used by the RFCS as a result of meeting the water heating load during hour i at ambient temperature T_i (for an <i>indoor</i> unit), L (gal)
$V_{w,whH,i}$	water used by the RFCS as a result of meeting the water heating load during hour i at ambient temperature T_H (for an <i>outdoor</i> unit), L (gal)
$V_{w,whL,i}$	water used by the RFCS as a result of meeting the water heating load during hour i at ambient temperature T_L (for an <i>outdoor</i> unit), L (gal)

X_q	part-load thermal output factor for electrical load following applications that indicates the fraction of the rated thermal output that occurs at electrical part-load ratio, r_e , and ambient temperature T_a (for an <i>outdoor</i> unit)
X_q^*	part-load thermal output factor for electrical load following applications that indicates the fraction of the rated thermal output that occurs at electrical part-load ratio, r_e , and ambient temperature T_I (for an <i>indoor</i> unit)
X_f	part-load fuel use factor for electrical load following applications that indicates the fraction of the rated fuel use rate that occurs at electrical part-load ratio, r_e , and ambient temperature T_a (for an <i>outdoor</i> unit)
X_f^*	part-load fuel use factor for electrical load following applications that indicates the fraction of the rated fuel use rate that occurs at electrical part-load ratio, r_e , and ambient temperature T_I (for an <i>indoor</i> unit)
X_v^*	part-load ventilation airflow factor for electrical load following applications that indicates the fraction of the rated ventilation airflow that occurs at electrical part-load ratio, r_e , and ambient temperature T_I (for an <i>indoor unit that uses indoor air for ventilation</i>)
X_w	part-load water use factor for electrical load following applications that indicates the fraction of the rated water use that occurs at electrical part-load ratio, r_e , and ambient temperature T_a (for an <i>outdoor</i> unit)
X_w^*	part-load water use factor for electrical load following applications that indicates the fraction of the rated water use that occurs at electrical part-load ratio, r_e , and ambient temperature T_I (for an <i>indoor</i> unit)
$Y_{CO_2}^{dry}$	volume fraction of CO ₂ in dry exhaust gas
$Y_{CO_2}^0$	volume fraction of CO ₂ in ambient air
Z_e	part-load power output factor for thermal load following applications that indicates the fraction of the rated power output that occurs at thermal part-load ratio, r_t , and ambient temperature T_a (for an <i>outdoor</i> unit)
Z_e^*	part-load power output factor for thermal load following applications that indicates the fraction of the rated power output that occurs at thermal part-load ratio, r_t , and ambient temperature T_I (for an <i>indoor</i> unit)
Z_f	part-load fuel use factor for thermal load following applications that indicates the fraction of the rated fuel use rate that occurs at thermal part-load ratio, r_t , and ambient temperature T_a (for an <i>outdoor</i> unit)
Z_f^*	part-load fuel use factor for thermal load following applications that indicates the fraction of the rated fuel use rate that occurs at thermal part-load ratio, r_t , and ambient temperature T_I (for an <i>indoor</i> unit)
Z_v^*	part-load ventilation airflow factor for thermal load following applications that indicates the fraction of the rated ventilation airflow that occurs at thermal part-load ratio, r_t , and ambient temperature T_I (for an <i>indoor unit that uses indoor air for ventilation</i>)

Z_w	part-load water use factor for thermal load following applications that indicates the fraction of the rated water use that occurs at thermal part-load ratio, r_t , and ambient temperature T_a (for an <i>outdoor</i> unit)
Z_w^*	part-load water use factor for thermal load following applications that indicates the fraction of the rated water use that occurs at thermal part-load ratio, r_t , and ambient temperature T_i (for an <i>indoor</i> unit)
ρ_a^0	density of air at standard conditions (T^0 ; P^0), kg/L (lb _m /ft ³)
ρ_c	density of water at T_{ci} , kg/L (lb _m /ft ³)
ρ_h	density of the heat transfer fluid evaluated at the temperature of the fluid at the flow measurement point, kg/L (lb _m /ft ³)
ρ_f^0	density of the fuel at standard conditions (T^0 ; P^0), kg/L (lb _m /ft ³)
ω_a	humidity ratio of the ambient air, kg-water/kg-dry air (lb _m -water/lb _m -dry air)

4. Classification

Residential fuel cell systems may be classified into four types according to the interaction of the system with the electrical grid and with the thermal load for the residence.

4.1 Type I: Grid independent, electrical load following RFCS

Residential fuel cell systems for grid independent applications strive to meet the electrical loads of the residence at all times using either power supplied directly by the fuel cell stack or using supplemental power supplied by storage sub-systems (e.g., batteries or capacitors) that are part of the fuel cell system. Thermal energy produced during fuel cell system operation can be supplied to the residence for space heating and/or domestic water heating¹.

4.2 Type II: Grid interconnected, constant power RFCS

Residential fuel cell systems for grid interconnected applications can use power from the utility grid to supplement fuel cell power during periods of high electrical load by the residence and can supply power to the grid during periods of low electrical load. In addition, the fast response of the electrical grid can be used to meet transient load conditions. Thus grid connected fuel cell combined heat and power (CHP) systems can operate to produce constant electrical power. As with the grid independent system, thermal energy produced during fuel cell system operation can be supplied to the residence for space heating and/or water heating.

4.3 Type III: Grid interconnected, thermal load following RFCS

Residential fuel cell systems for grid interconnected thermal load following applications control the fuel cell operation in an attempt to satisfy the thermal load of the residence including the space heating load and/or the domestic water heating load. The coincident power production contributes to meeting the electrical load of the residence. Power from the grid is used to supplement the fuel cell power as required to meet the electrical load. If the coincident power exceeds the electrical load of the residence, the excess is transferred to the grid.

4.4 Type IV: Grid interconnected, RFCS for water heating

Residential fuel cell systems for grid interconnected water heating applications control the fuel cell operation to satisfy the water heating load. As with thermal load following applications, the coincident power production contributes to meeting the electrical load of the residence. Power from the grid is used to supplement the fuel cell power as required to meet the electrical load. If the coincident power exceeds the electrical load of the residence, the excess is transferred to the grid.

5. Instruments and Data Acquisition Systems

5.1 Instruments and Methods of Measurement

Instruments and methods of measurement shall be in accordance with the ASME Performance Test Code for Fuel Cell Power Systems [3].

¹ Although beyond the scope of this work, the thermal energy may also be used to power cooling devices such as absorption air conditioning.

5.2 Permissible variation in controls and uncertainty limits in measured values

Permissible variations for specific control parameters are specified in Tables 8.1 and 8.2.

An uncertainty analysis shall be conducted in accordance with the principles outlined in ASME PTC-50-2002, *Fuel Cell Power Systems Performance* [3], Appendix I and in ASME PTC 19.1-1988, *Test Uncertainty* [5]. Trade-offs may be made between individual instrument uncertainties as long as the overall measurement uncertainty in each value is within 2 %.

6. Apparatus

6.1 General

Fuel cell systems are complex systems that are comprised of multiple sub-systems and that use and yield mass and energy streams in a variety of forms. Figure 6.1 illustrates a generic fuel cell system and depicts the interaction of the system with the surroundings. For the purpose of this test procedure and rating methodology, the mass and energy streams of interest are:

- Electrical energy provided by the fuel cell system to the residence
- Electrical energy supplied by the residence to the fuel cell system
- Electrical energy supplied to external auxiliary devices (e.g., circulating water pumps)
- Thermal energy provided by the fuel cell system to the residence
- Fuel used by the fuel cell system
- Air extracted from the residence by the RFCS
- Water consumed by the fuel cell system

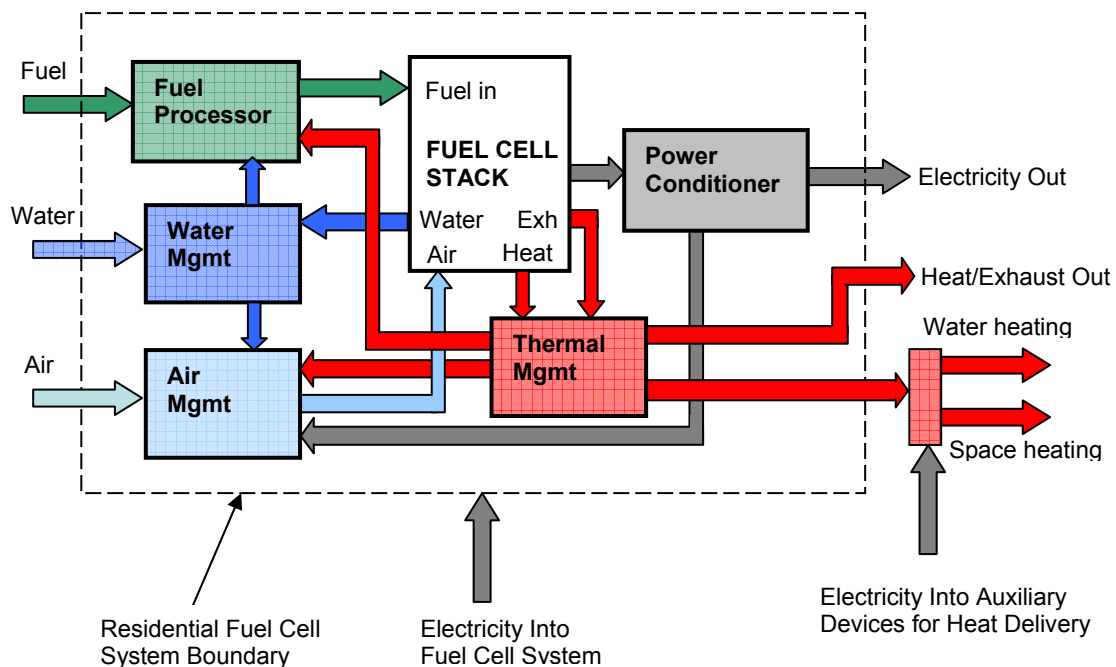


Figure 6.1 Residential fuel cell system and interactions with surroundings.

The test apparatus is designed to measure the interactions of the fuel cell system with the surroundings so that the fuel use and the net contribution of electrical and thermal energy to the residence can be determined.

6.2 Description of Test Apparatus

6.2.1 Overview

As illustrated in Figures 6.2 and 6.3, the test apparatus consists of an environmental chamber; a fuel supply and monitoring system; a power interface and monitoring system; a thermal energy interface and monitoring system; and a system for monitoring exhaust gas CO_2 content. The thermal energy supplied by the fuel cell is either transferred to a residential domestic water heater (as depicted in Figure 6.2 for the simulated-use test) or transferred to a circulating chilled water loop controlled to maintain a constant inlet water temperature to the fuel cell system (as depicted in Figure 6.3 for the steady-state test).

6.2.2 Environmental chamber

The environmental chamber must be capable of maintaining the temperature and relative humidity within the chamber at the specified test conditions while compensating for the thermal loads imposed by operation of the fuel cell system.

6.2.3 Fuel supply and monitoring system

Natural gas is supplied to the fuel cell system, and the temperature, pressure, and flow rate of the natural gas are monitored. In addition, the higher heating value of the fuel is determined by a calorimeter at the beginning and end of each test to confirm that the heating value is within acceptable limits.

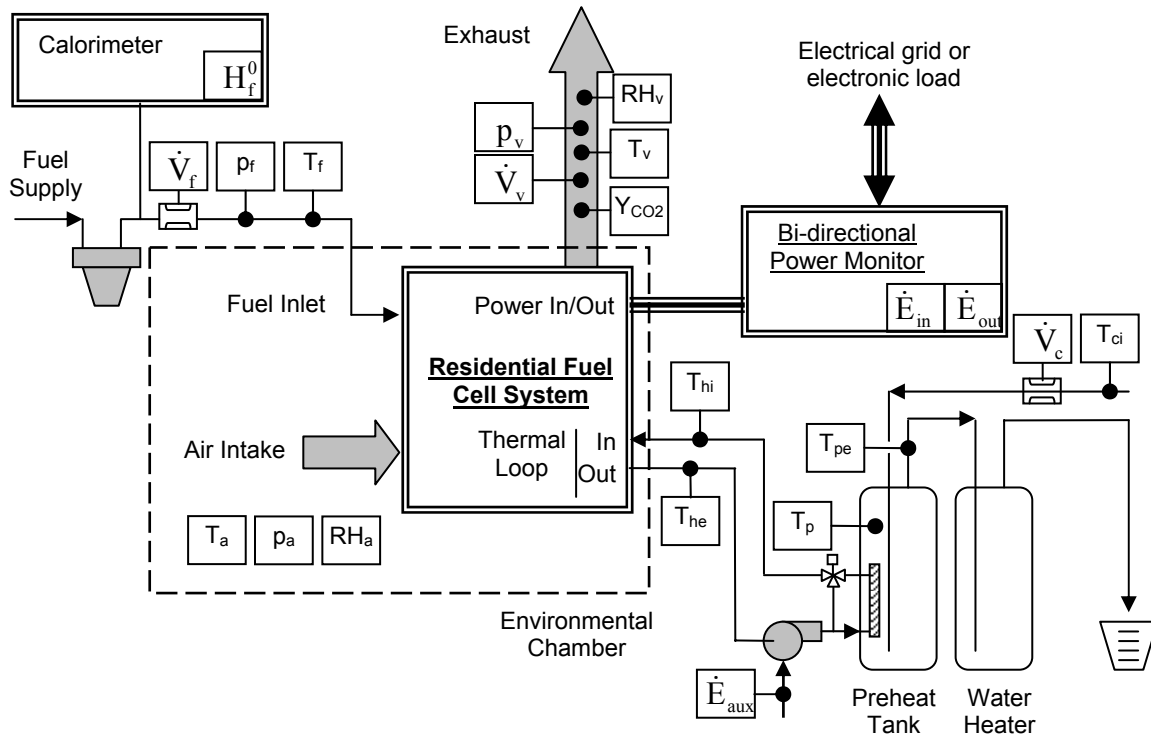


Figure 6.2. Test apparatus for hot water simulated-use test.

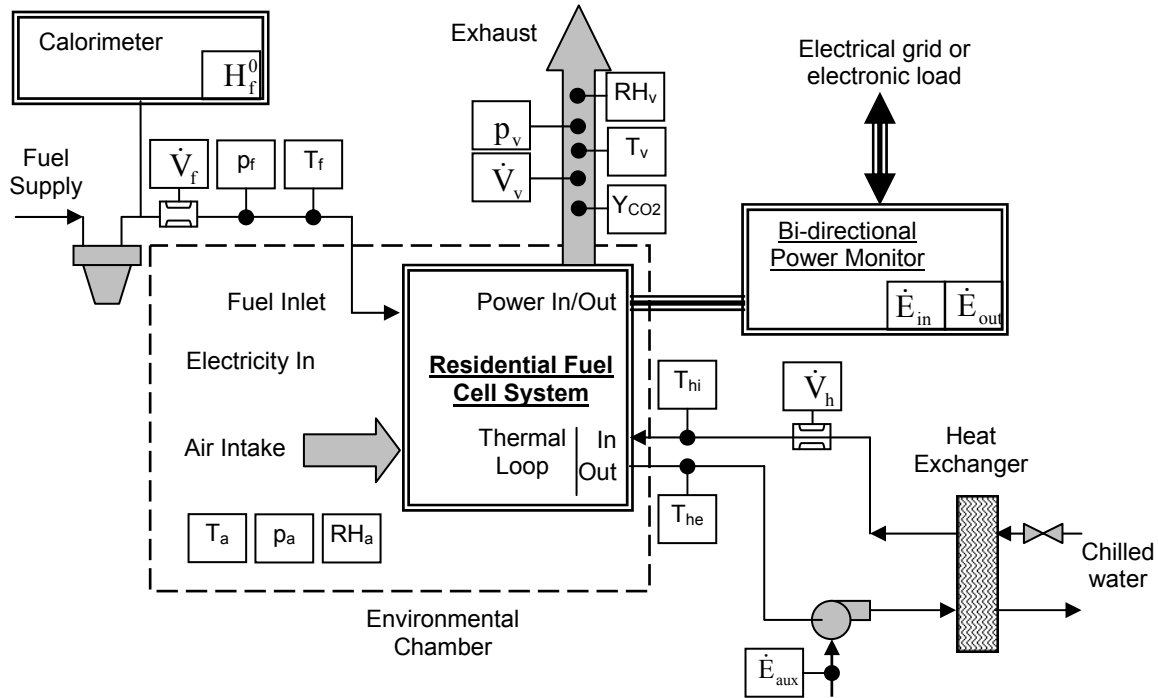


Figure 6.3. Test apparatus for steady-state test.

6.2.4 Power interface and monitoring system

A monitoring system will be implemented to measure the real power provided by the fuel cell to an electronic load or to the utility grid. Any power supplied from the grid to the fuel cell for start-up or for operation of auxiliary devices will also be monitored.

6.2.5 Thermal interface and monitoring system

A thermal interface consisting of a preheat tank, a water heater, and a heat exchanger are connected to the fuel cell system. Any external pumps required for system operation are supplied by the manufacturer and installed in accordance with the manufacturer's recommendations to circulate heat transfer fluid through the preheat tank and/or the heat exchanger. The characteristics of the thermal interface are specified in Table 6.1.

Table 6.1. Thermal interface characteristics and maximum permissible variation

Parameter	Value and allowable variation
Preheat tank volume	303 L (80 gal)
Preheat tank recovery (32 °C (90 °F) rise)	200 L/h (54 gal/h)
Preheat tank first hour delivery (32 °C (90 °F) rise)	475 L (125 gal)
Circulating fluid composition	Water and propylene glycol (PpG); 35 % PpG by volume ± 3 % PpG
Circulating fluid temperature and flow rate	See Table 8.1

In the simulated-use test, illustrated in Figure 6.2, circulating fluid from the fuel cell system is circulated through a double-wall heat exchanger located in the preheat tank. Cold water is supplied from the domestic cold water supply line to the preheat tank. Water from the preheat tank flows to the hot water tank to replace water extracted during the specified draws. Facilities are provided to maintain the cold water inlet temperature to the preheat tank within the temperature range specified in Table 8.1. The mean tank temperature for the preheat tank and the hot water tank are monitored by temperature probes. Controls are installed and operated as recommended by the manufacturer to control the preheat tank temperature. In addition to these controls, a means shall be provided by the manufacturer to stop the transfer of heat from the RFCS to the preheat tank if the preheat tank exceeds the high temperature limit. The temperature and flow rate of water entering the preheat tank and the temperature of water leaving the preheat tank are monitored to determine the thermal energy supplied by the fuel cell system to the preheat tank.

In the steady-state test, illustrated in Figure 6.3, circulating fluid from the fuel cell system will be circulated through a heat exchanger. The flow of chilled water supplied to the other side of the heat exchanger is controlled to maintain the temperature of the water supplied to the fuel cell within the specified range. The temperature and flow rate of circulating fluid entering the heat exchanger and the temperature of circulating fluid leaving the heat exchanger are monitored to determine the thermal energy supplied by the fuel cell system.

6.2.6 Power to auxiliary devices

Any power provided to the fuel cell system or used to operate external pumps or auxiliary devices shall be measured using real power meters, recorded, and subtracted from the fuel cell system output power to determine the net power.

6.2.7 Exhaust gas monitoring

The temperature of the exhaust gas is monitored, and instrumentation is provided to withdraw a sample of the exhaust gas, dry the sample, and measure the CO₂ content of the sample. The sample will be withdrawn downstream of any mixing dampers in the exhaust system so that the sample reflects the diluting effect of any air withdrawn from the environmental chamber by the fuel cell system operation. The CO₂ content will be used in conjunction with the fuel flow rate to determine the inlet air flow rate.

7. Methods of Test

7.1 Required tests by fuel cell type

Each fuel cell type requires a specific set of tests to evaluate its performance. The tests consist of two types:

7.1.1 Simulated-use test

The simulated use test is a 24 h transient test that represents the energy used for water heating. Water is withdrawn from the water heater (and thus the preheat tank) according to a schedule that is similar to the Department of Energy Test Procedure for Water Heaters⁵. The thermal energy supplied by the RFCS/preheat tank system to the incoming water is monitored. The simulated-use test can be conducted while the fuel cell system is supplying electricity at a specific power level or can be conducted in a thermal load following mode

in which the fuel cell system operates only as needed to heat the water. The simulated-use tests to be conducted for each fuel cell system type are specified in Table 7.1.

7.1.2 Steady-state test

The steady-state test is a test of fuel cell performance at steady inlet fluid temperature and flow rate. The steady-state test is conducted at a specified electrical power or thermal output rate. The steady-state tests to be conducted for each fuel cell system type are specified in Table 7.1.

7.1.3 Transient electrical power test

The transient electrical power test is a test of fuel cell performance at steady inlet fluid temperature and flow rate and an oscillating electrical power requirement. The transient electrical power test is conducted while the electrical load oscillates between minimum and maximum power. The transient electrical power test is conducted only for a Type I RFCS.

7.2 Environmental conditions for testing

Residential fuel cell system tests shall be conducted at ambient conditions that span the typical operating range for the unit.

Units rated for indoor installation. Residential fuel cell systems rated for indoor installation will be tested at ambient conditions of 22 °C (72 °F) and 50 % relative humidity.

Units rated for outdoor installations. For residential fuel cell systems rated for outdoor installation, each set of tests specified in Table 7.1 shall be conducted at ambient conditions of:

$$T_L = -15\text{ °C (5 °F) and } 80\text{ \% RH and } T_H = 35\text{ °C (95 °F) and } 50\text{ \% RH.}$$

Table 7.1. Tests required for an outdoor residential fuel cell system type.

Test	Grid Independent Electrical Load Following (Type I)		Grid Connected Constant Power (Type II)		Grid Connected Thermal Load Following (Type III)		Grid Connected Water Heating (Type IV)	
	T _H	T _L	T _H	T _L	T _H	T _L	T _H	T _L
Hot water simulated-use test conducted at								
Maximum power	X	X						
Minimum power	X	X						
Rated power			X	X				
Thermal load following					X	X	X	X
Steady-state test conducted at								
Maximum power	X	X						
Midpoint power	X	X						
Minimum power	X	X						
Rated power			X	X				
Maximum thermal energy delivery					X	X		
Midpoint thermal energy delivery					X	X		
Minimum thermal energy delivery					X	X		
Transient: Min to max power	X	X						

8. Test Procedures

8.1 Hot water simulated-use test

8.1.1 Operating conditions

Table 8.1. Operating conditions and permissible variations for hot water simulated-use test.

Parameter	Operating Condition	Maximum Permissible Variation
Real power output, kW	As specified for test or thermal load following	± 2 % (except for thermal load following test)
Ambient temperature	As specified for test	± 1.7 °C (3°F)
Ambient relative humidity	As specified for test	± 5 %RH
Heating value of fuel		± 1 %
Fuel pressure at fuel cell inlet		± 1 %
Fuel cell thermal loop flow rate	As specified in Note 1.	± 2 %
Make-up water temperature	14.4 °C (58 °F)	± 1.1 °C (2 °F)
Cold water temperature	14.4 °C (58 °F)	± 1.1 °C (2 °F)
Preheat tank operating temperature	As specified in Note 2.	
Preheat tank high limit	57.2 °C (135 °F)	± 2.8 °C (± 5 °F)

Notes:

1. The water flow rate through the fuel cell circulating loop, \dot{V}_h , shall be set in accordance with the manufacturer's recommendations. In the absence of manufacturer's recommendations, the flow rate shall be adjusted to produce a water temperature rise of $11\text{ °C} \pm 1.1\text{ °C}$ ($20\text{ °F} \pm 2\text{ °F}$) at the unit's maximum rated power.
2. The operating control for the preheat tank temperature shall be set at a temperature designated by the RFCS manufacturer and the unit shall operate within the standard control range specified by the manufacturer except that the preheat tank temperature shall not be exceed the preheat tank high limit temperature indicated in Table 8.1.

8.1.2 Initialization.

The test begins following the initiation of normal operation of the fuel cell to maintain the mean preheat tank temperature as specified in Table 8.1. After the initial cutout², or any subsequent cutout, $40.6\text{ L} \pm 1.9\text{ L}$ (10.7 gal ± 0.5 gal) are drawn at a rate of $0.19\text{ L/s} \pm 0.015\text{ L/s}$ (3 gal/min ± 0.25 gal/min). Thirty minutes later, $40.6\text{ L} \pm 1.9\text{ L}$ (10.7 gal ± 0.5 gal) are drawn at the same rate.

8.1.3 Water heating simulated-use test procedure

The simulated-use test is conducted over a 24 h period with an initial 15 h standby period followed by 6 draw periods each having a duration of one hour followed by a 3 h standby period. The test begins when the tank temperature is restored to the operating condition specified in Table 8.1 following the second draw specified in 8.1.2. When the mean tank

² Cutout refers to a control operation that reduces or stops the thermal output from the RFCS when the tank temperature setpoint is satisfied.

temperature reaches the specified value, data acquisition is initiated. The system operates to maintain the mean tank temperature at the specified value for the first 15 h of the test. After an elapsed time of 15 h, a volume equal to 40.6 L (10.7 gal) is withdrawn from the water heater at a rate of $0.19 \text{ L/s} \pm 0.015 \text{ L/s}$ ($3 \text{ gal/min} \pm 0.25 \text{ gal/min}$). At elapsed times of 16, 17, 18 and 19 h, additional draws are initiated each having the same volume and flow rate as the initial draw. At an elapsed time of 20 h, the quantity of the draw shall be increased or decreased as necessary such that the total volume of water withdrawn during the entire test equals $243.4 \text{ L} \pm 3.8 \text{ L}$ ($64.3 \text{ gal} \pm 1.0 \text{ gal}$). The maximum allowable deviation from the mean for any single draw shall be $1.9 \text{ L} (\pm 0.5 \text{ gal})$.

The system is allowed to continue to operate to maintain the preheat tank at the operating temperature until 24 h have elapsed from the start of the test. After an elapsed time of 23 h, the RFCS is stopped. If recovery is occurring at an elapsed time of 23 h, operation of the RFCS continues until recovery is complete before the RFCS is stopped.

8.1.4 Test results

Initial values are recorded for the test data and data is recorded as specified in Table 8.4 throughout the 24 h test period.

8.2 Steady-state test

8.2.1 Operating conditions

Operating conditions and maximum permissible variations for the steady state test shall be as specified in Table 8.2.

8.2.2 Initialization.

The test begins following the initiation of normal operation of the fuel cell. Operation is maintained until continuous monitoring indicates that variations in the operating conditions are within the maximum permissible ranges specified in Table 8.2.

Table 8.2. Operating conditions and maximum permissible variations for steady state test.

Parameter	Operating Condition	Maximum Permissible Variation
Real power output, kW	As specified for test	$\pm 2 \%$
Ambient temperature	As specified for test	$\pm 1.7 \text{ }^{\circ}\text{C}$ ($3 \text{ }^{\circ}\text{F}$)
Ambient relative humidity	As specified for test	$\pm 5 \%$ RH
Heating value of fuel		$\pm 1 \%$
Fuel pressure at fuel cell inlet		$\pm 1 \%$
Fuel cell thermal loop inlet temp.	$50 \text{ }^{\circ}\text{C}$ ($122 \text{ }^{\circ}\text{F}$)	$\pm 1.1 \text{ }^{\circ}\text{C}$ ($2 \text{ }^{\circ}\text{F}$)
Make-up water temperature	$14.4 \text{ }^{\circ}\text{C}$ ($58 \text{ }^{\circ}\text{F}$)	$\pm 1.1 \text{ }^{\circ}\text{C}$ ($2 \text{ }^{\circ}\text{F}$)
Fuel cell thermal loop flow rate	As specified in Note.	$\pm 2 \%$
Thermal energy output rate	Response	$\pm 2 \%$
Fuel flow rate	Response	$\pm 2 \%$
Auxiliary power input	Response	$\pm 2 \%$

Note: The water flow rate through the fuel cell circulating loop, \dot{V}_h , shall be adjusted to yield a water temperature rise of $11 \text{ }^{\circ}\text{C}$ ($20 \text{ }^{\circ}\text{F}$) at the maximum rated power of the unit.

8.2.3 Test results

Test results include all data specified in Table 8.4 recorded at the indicated intervals through the duration of the test. The data is analyzed to determine the mean steady-state values and the variation of each parameter.

8.3 Transient electrical power test

8.3.1 Operating conditions

Operating conditions and maximum permissible variations for the transient electrical power test shall be as specified in Table 8.3.

8.3.2 Initialization and test procedure

The test begins following the initiation of normal operation of the fuel cell at maximum power. Operation is maintained until continuous monitoring indicates that variations in the operating conditions are within the maximum permissible ranges specified in Table 8.2. The electrical load is then reduced in a step change (< 1 s) to minimum power. The system operates at minimum power for 15 min. The electrical load is then increased in a step change (< 1 s) to maximum power. The system operates at maximum power for 15 min. The cycle is repeated 8 times for a total test duration of 4 h.

8.3.3 Test results

Test results include all data specified in Table 8.4 recorded at the indicated intervals through the duration of the test. The data are analyzed to determine the changes in thermal output and fuel use associated with transient electrical loads.

Table 8.3. Operating conditions and maximum permissible variations for steady state test.

Parameter	Operating Condition	Maximum Permissible Variation
Real power output, kW	See Section 8.3.2.	± 2 % at each power level
Ambient temperature	As specified for test	± 1.7 °C (3 °F)
Ambient relative humidity	As specified for test	± 5 %RH
Heating value of fuel		± 1 %
Fuel pressure at fuel cell inlet		± 1 %
Fuel cell thermal loop inlet temp.	50 °C (122 °F)	± 1.1 °C (2 °F)
Make-up water temperature	14.4 °C (58 °F)	± 1.1 °C (2 °F)
Fuel cell thermal loop flow rate	As specified in Note.	± 2 %
Thermal energy output rate	Response	N.A.
Fuel flow rate	Response	N.A.
Auxiliary power input	Response	N.A.

Note: The water flow rate through the fuel cell circulating loop, \dot{V}_h , shall be adjusted to yield a water temperature rise of 11 °C (20 °F) at the maximum rated power of the unit.

8.4 Data acquisition

Data for each test will be measured and recorded as specified in Table 8.4.

Table 8.4. Monitoring points and frequencies for simulated-use, steady-state, and transient tests

Variable	Description	Measurement Frequency	
		Simulated- Use Test	Steady-state and Transient Tests
\dot{E}_{in}	electrical power supplied to fuel cell system, kW	A	A
\dot{E}_{out}	electrical power supplied by the fuel cell system, kW	A	A
\dot{E}_{aux}	electrical power supplied to auxiliary devices not powered by the RFCS, kW	A	A
p_a	absolute pressure of air surrounding the RFCS, kPa (psia)	A	A
p_f	absolute pressure of fuel gas at flow measurement point, kPa (psia)	A	A
RH_a	relative humidity of the ambient air, %	A	A
RH_v	relative humidity of the exhaust from the RFCS, %	A	A
T_a	temperature of air surrounding the RFCS, °C (°F)	A	A
T_{ci}	temperature of cold water entering the preheat tank, °C (°F)	A	N.A.
T_f	absolute temperature of fuel gas, K (R)	A	A
T_{he}	temperature of circulating fluid at the exit from the RFCS, °C (°F)	A	A
T_{hi}	temperature of circulating fluid at the inlet to the RFCS, °C (°F)	A	A
T_p	temperature of water in preheat tank, °C (°F)	A	N.A.
T_{pe}	temperature of water leaving preheat tank, °C (°F)	A	N.A.
T_v	absolute temperature of the exhaust gas, K (R)	A	A
\dot{V}_c	volumetric flow of cold water into the preheat tank, L/s (gal/min.)	A	N.A.
\dot{V}_f	volumetric flow rate of fuel gas, L/h (ft ³ /h)	A	A
\dot{V}_h	volumetric flow rate of circulating fluid through the RFCS, L/s (ft ³ /h)	A	A
HHV_f^0	higher heating value of fuel gas at standard conditions (T^0 ; P^0), kJ/L (Btu/ft ³)	A or B	A or B
Y_{CO_2}	volume fraction of CO ₂ in dry exhaust gas	A	A

Measurement frequency legend

A = measure and record initial value and subsequent values at 30 s intervals.

B = measure at the beginning and the end of the test procedure and average.

N.A. = not applicable.

8.5 Safety

Fuel cell systems typically involve high voltage electrical systems, flammable gases, compressed gases, and high temperatures and thus present a number of hazards. Performance testing systems and procedures must comply with applicable codes and regulations for construction, operation, and worker safety. Applicable codes for system installation may include but are not limited to the standards of the NFPA such as:

NFPA 853: Standard for the Installation of Stationary Fuel Cell Power Plants

NFPA 70: National Electrical Code (including Article 692: Fuel Cell Systems)

NFPA 54: National Fuel Gas Code

as well as the requirements of IEEE Standard 1547 for Interconnecting Distributed Resources With Electric Power Systems.

Test procedures must be conducted by personnel who are properly trained and aware of the hazards and necessary safety procedures for working with fuel systems, electrical systems, and fuel cell systems.

9. Data Analysis

9.1 General description

Each system rated by this procedure is tested to determine the values specified in Table 8.4 for each experiment specified in Table 7.1. The data from each experiment are used to calculate mass and energy flow rates. The steady state mass and energy flow rates are used to evaluate performance at nominal (or rated) conditions. For electrical load following (Type I) and thermal load following (Type III) systems, the mass and energy flow rates are also used to establish functional relationships for part-load performance that are then used in the rating procedure. The mass and energy flow rates from the simulated use tests are used to determine the fuel use and the energy provided to a domestic water preheat tank during each hour of the test procedure. The following sections describe the procedures for determining the mass and energy flow rates, establishing the rated performance, determining functional relationships for part-load performance, and evaluating the hourly performance for the simulated use test.

9.2 Calculation of Mass and Energy Flow Rates

9.2.1 Fuel use rate

The rate at which fuel energy is used by the fuel cell system, \dot{F} , expressed in kW (Btu/h) is determined by:

$$\dot{F} = \dot{V}_f \times \text{HHV}_f^0 \times \frac{T^0}{T_f} \frac{p_f}{p^0} \times C_1 \quad (9-1)$$

where:

\dot{V}_f is the volumetric flow rate of the fuel, L/h (ft³/h)

HHV_f^0 higher heating value of fuel gas at standard conditions (T^0 ; P^0), kJ/L (Btu/ft³)

T^0 is standard temperature, 298 K (537 R)

T_f is the temperature of the fuel gas at the inlet to the RFCS, K (R)

p^0 is standard pressure, 101.3 kPa (14.7 psia)

p_f is the pressure of the fuel gas at the inlet to the RFCS, kPa absolute (psia)

C_1 is a units conversion factor, $C_1 = 1 \text{ kW}\cdot\text{h}/3600 \text{ kJ}$ (1 Btu/Btu)

9.2.2 Net electrical power

The net electrical power provided by the fuel cell system, \dot{E}_{fc} , in kW is determined by³:

$$\dot{E}_{fc} = \dot{E}_{out} - \dot{E}_{in} - \dot{E}_{aux} \quad (9-2)$$

where:

³ The quantity $\dot{E}_{out} - \dot{E}_{in}$ in Eq. (9-2) can be measured directly in lieu of measure the components and calculating the difference. The power for auxiliary devices external to the fuel cell, $\dot{E}_{out} - \dot{E}_{in}$ must be subtracted to the yield the net electrical power.

\dot{E}_{out} is the power supplied by the RFCS, kW

\dot{E}_{in} is the power supplied to the RFCS, kW

\dot{E}_{aux} is the power supplied to any devices external to the RFCS that are required for fuel cell operation (e.g., external circulating pumps), kW.

9.2.3 Steady-state thermal output rate

During the steady-state test, the thermal output rate from the RFCS, \dot{Q}_{fc} , in kW (Btu/h) is determined by:

$$\dot{Q}_{fc} = \rho_h \dot{V}_h c_h (T_{he} - T_{hi}) \quad (9-3)$$

where:

ρ_h is the density of the circulating fluid evaluated at the temperature at the flow measurement point, kg/L (lb_m/ft³)

\dot{V}_h volumetric flow rate of circulating fluid through the RFCS, L/s (ft³/h)

c_h is the specific heat of the circulating fluid evaluated at the average of the fuel cell system inlet and outlet temperatures, kJ/kg·°C (Btu/lb_m·°F)

T_{he} is the temperature of the circulating fluid exiting the RFCS, °C (°F)

T_{hi} is the temperature of the circulating fluid entering the RFCS, °C (°F).

9.2.4 Simulated-use thermal output rate

During the simulated-use test, the useful thermal energy provided for water heating by the RFCS in combination with the specified preheat tank, \dot{Q}_{wh} , in kW (Btu/h) is given by:

$$\dot{Q}_{wh} = \rho_c \dot{V}_c c_c (T_{pe} - T_{ci}) \quad (9-4)$$

where:

ρ_c is the density of water at T_{ci} , kg/L (lb_m/ft³)

\dot{V}_c is the volumetric flow rate of cold water into the preheat tank L/s (ft³/h)

c_c is the specific heat of water evaluated at the average of the cold water inlet and preheat tank outlet temperatures, kJ/kg·°C (Btu/lb_m·°F)

T_{pe} is the temperature of the water leaving the preheat tank, °C (°F)

T_{ci} is the temperature of cold water entering the preheat tank, °C (°F).

9.2.5 Thermal loss rate

During the simulated-use test, the thermal energy lost to the environment is determined by:

$$\dot{Q}_{loss} = \dot{Q}_{fc} - \dot{Q}_{wh} \quad (9-5)$$

where \dot{Q}_{wh} and \dot{Q}_{fc} are calculated as shown above.

9.2.6 Ventilation airflow rate

For a RFCS that uses indoor air, the air supplied to the fuel cell system may be extracted from the house. If the air is extracted from the indoors, it must be replenished by outdoor air, and the RFCS output must be corrected to account for the energy to condition the outdoor air. For units that use indoor air for ventilation, the rate at which air is supplied to the RFCS, is determined based on the flow rate of fuel, the composition of the fuel gas, and the mole fraction of carbon dioxide in a dry sample of the exhaust from the RFCS. In addition, since the RFCS may operate intermittently, the exhaust flow rate is monitored directly to determine the airflow during pre- and post-purge cycles.

When carbon dioxide is present in the exhaust stream at concentrations exceeding the ambient value (indicating that fuel is reacting in the RFCS) the mass basis air-to-fuel ratio, r_{af} , is given by:

$$r_{af} = \frac{7.2127 + 7.2424\omega_a}{12r + s + 16t} \left[\frac{4}{Y_{CO_2}^{dry}} r + s - 2t \right] \quad (9-6)$$

where:

$Y_{CO_2}^{dry}$ is the volume fraction of CO_2 in dry exhaust gas

r, s, t are determined by the fuel composition expressed as $C_rH_sO_t$

ω_a is the humidity ratio of the ambient air, kg-water/kg-dry air (lb_m-water/lb_m-dry air):

$$\omega_a = \frac{0.622 \times RH_a \times p_s(T_a)}{p_a - RH_a \times p_s(T_a)} \quad (9-7)$$

where:

p_a is the pressure of the ambient air surrounding the RFCS, kPa-absolute (psia)

T_a is the absolute temperature ambient air surrounding the RFCS, K (R)

$p_s(T_a)$ is the saturation pressure of water at T_a , kPa (psia)

The airflow rate into the RFCS in kg/h (lb_m/h) can then be found based on the fuel flow:

$$\dot{m}_a^{on} = r_{af} \rho_f^0 \frac{p_f}{p^0} \frac{T^0}{T_f} \dot{V}_f \text{ if } Y_{CO_2}^{dry} > Y_{CO_2}^0; \text{ else } 0 \quad (9-8)$$

where variables are as previously defined and:

ρ_f^0 is the density of the fuel at standard conditions (T^0 ; p^0), kg/L (lb_m/ft³)

When the concentration of carbon dioxide in the exhaust gas does not exceed the ambient value, the exhaust is assumed to be comprised solely of air and the mass flow rate of air is determined from:

$$\dot{m}_a^{off} = \rho_a^0 \frac{p_v}{p^0} \frac{T^0}{T_v} \dot{V}_v \text{ if } Y_{CO_2}^{dry} \leq Y_{CO_2}^0; \text{ else } 0 \quad (9-9)$$

where variables are as previously defined and:

ρ_a^0 is the density of air at standard conditions (T^0 ; P^0), kg/L (lb_m/ft³)

\dot{V}_v is the volumetric flow rate of the exhaust gas, L/h (ft³/h)

Steady-state ventilation airflow rate

The rate at which ventilation air is supplied to the RFCS during the steady state test expressed in L/h (ft³/h) is given by:

$$\dot{m}_a = \frac{1}{t_f - t_i} \int_{t=t_i}^{t=t_f} (\dot{m}_a^{\text{on}} + \dot{m}_a^{\text{off}}) dt \quad (9-10)$$

where t_i and t_f are the initial and final times of the steady state test measured in hours.

Simulated-use ventilation airflow

The ventilation air supplied to the RFCS during hour i of the simulated use test expressed in L (ft³) is given by:

$$m_{a,i} = \int_{t=t_{i-1}}^{t=t_i} (\dot{m}_a^{\text{on}} + \dot{m}_a^{\text{off}}) dt \quad (9-11)$$

where t_{i-1} and t_i are the initial and final times, respectively, of hour i expressed in hours.

9.2.7 Water use

The rate at which water is supplied to the RFCS, is determined based on the flow rate of fuel, the composition of the fuel gas, the relative humidity of the inlet air, the mole fraction of carbon dioxide in a dry sample of the exhaust from the RFCS, and the relative humidity of the exhaust gas. In addition, since the RFCS may operate intermittently, the exhaust flow rate is monitored directly (along with the inlet and exhaust relative humidity values) to determine the water added to the air stream during pre- and post-purge cycles.

When carbon dioxide is present in the exhaust stream at concentrations exceeding the ambient value (indicating that fuel is reacting in the RFCS) the mass basis water-to-fuel ratio, r_{wf} , is given by:

$$r_{wf} = \left[\left(\frac{p_s(T_v) \times RH_v}{Y_{CO_2}^{\text{dry}} (p_v - p_s(T_v) \times RH_v)} - \frac{1.6082\omega_a}{Y_{CO_2}^{\text{dry}}} \right) r - (0.4020\omega_a + 0.5)s + (0.8041\omega_a)t \right] \times \frac{18.015}{12r + s + 16t} \quad (9-12)$$

where variables are as previously defined and:

$p_s(T_v)$ is the saturation pressure of water at T_v , kPa (psia)

ω_v is the humidity ratio of the exhaust air, kg-water/kg-dry air (lb_m-water/lb_m-dry air)

RH_v is the relative humidity of the exhaust air

The water flow rate into the RFCS in L/h (gal/h) can then be found based on the fuel flow rate:

$$\dot{V}_w^{\text{on}} = r_{wf} \frac{\rho_f^0}{\rho_w} \frac{p_f}{p^0} \frac{T^0}{T_f} \dot{V}_f \quad \text{if } Y_{CO_2}^{\text{dry}} > Y_{CO_2}^0; \text{ else } 0 \quad (9-13)$$

where variables are as previously defined and

ρ_w is the density of water at standard conditions, kg/L (lb_m/gal)

When the concentration of carbon dioxide in the exhaust gas does not exceed the ambient value, the exhaust is assumed to be comprised solely of air and the volumetric flow rate of water supplied to the RFCS in L/h (gal/h) is determined from:

$$\dot{V}_w^{\text{off}} = \frac{\rho_a^0}{\rho_w} \frac{p_v}{p^0} \frac{T^0}{T_v} \dot{V}_v (\omega_v - \omega_a) \text{ if } Y_{\text{CO}_2}^{\text{dry}} \leq Y_{\text{CO}_2}^0; \text{ else } 0 \quad (9-14)$$

where variables are as previously defined and:

ω_a is the humidity ratio of the inlet air, kg-water/kg-dry air (lb_m-water/lb_m-dry air)

Steady-state water use rate

The rate at which water is used by the RFCS during the steady state test expressed in L/h (gal/h) is given by:

$$\dot{V}_{w,ss} = \frac{1}{t_f - t_i} \int_{t=t_i}^{t=t_f} (\dot{V}_w^{\text{on}} + \dot{V}_w^{\text{off}}) dt \quad (9-15)$$

where t_i and t_f are the initial and final times of the steady state test measured in hours.

Simulated-use water consumption.

The water used during hour i expressed in L (gal) is given by:

$$V_{w,i} = \int_{t=t_{i-1}}^{t=t_i} (\dot{V}_w^{\text{on}} + \dot{V}_w^{\text{off}}) dt \quad (9-16)$$

where t_{i-1} and t_i are the initial and final times, respectively, of hour i expressed in hours.

9.3 Transient Electrical Load Factors

For systems operating in an electrical load following mode, the fuel use and thermal output can be affected by transient electrical loads. Correction factors are determined for the fuel use and thermal output based on the results from the transient electrical test. The transient electrical load correction factor for the fuel use, K_{tf} , is given by:

$$K_{tf} = \frac{\int_{t_{t1}}^{t_{t2}} \dot{F} dt}{(t_{t2} - t_{t1}) \dot{F}_{ss}} \quad (9-17)$$

where

t_{t1} is the time at the beginning of the transient electrical test, h

t_{t2} is the time at the end of the transient electrical test, h

\dot{F}_{ss} is the average rate of fuel use by the RFCS during the steady state test, kW (Btu/h)

The transient electrical load correction factor for the thermal output, K_{tq} , is given by:

$$K_{tq} = \frac{\int_{t_{t1}}^{t_{t2}} \dot{Q}_{fc} dt}{(t_{t2} - t_{t1}) \dot{Q}_{fc,ss}} \quad (9-18)$$

where variables are as previously defined and:

$\dot{Q}_{fc,ss}$ is the average thermal output by the RFCS during the steady state test, kW (Btu/h)

10. Calculation of System Performance Ratings

10.1 General Description

The performance test method is based on the predicted response of the system to typical residential space heating loads and to the domestic hot water loads specified within the DOE test procedure [6] for domestic water heaters. The predicted response of the system to each load condition is based on the results of the tests described previously and on the methodology outlined in the following sections for each system type.

The residential loads are developed for three days representing typical winter, spring/fall, and summer days. Predicted results for the electrical energy supplied to the residence, electrical energy supplied to the grid, thermal energy supplied for water heating, thermal energy supplied for space heating, fuel use, and water use are summed over each standard day and weighted by the number of days represented by each standard day. The following expressions define the annual energy results:

Annual electrical energy supplied to the residence (AE) in kW·h

$$AE = 91 \times \sum_{i=1}^{24} E_i^A + 183 \times \sum_{i=1}^{24} E_i^B + 91 \times \sum_{i=1}^{24} E_i^C \quad (10-1)$$

Annual electrical energy supplied to the utility grid (AG) in kW·h

$$AG = 91 \times \sum_{i=1}^{24} G_i^A + 183 \times \sum_{i=1}^{24} G_i^B + 91 \times \sum_{i=1}^{24} G_i^C \quad (10-2)$$

Annual thermal energy supplied for water heating (AQ_{wh}) in kW·h (Btu)

$$AQ_{wh} = 91 \times \sum_{i=1}^{24} Q_{wh,i}^A + 183 \times \sum_{i=1}^{24} Q_{wh,i}^B + 91 \times \sum_{i=1}^{24} Q_{wh,i}^C \quad (10-3)$$

Annual thermal energy supplied for space heating (AQ_{sh}) in kW·h (Btu)

$$AQ_{sh} = 91 \times \sum_{i=1}^{24} Q_{sh,i}^A + 183 \times \sum_{i=1}^{24} Q_{sh,i}^B + 91 \times \sum_{i=1}^{24} Q_{sh,i}^C \quad (10-4)$$

Annual fuel energy supplied to the fuel cell system (AF) in kW·h (Btu)

$$AF = 91 \times \sum_{i=1}^{24} F_i^A + 183 \times \sum_{i=1}^{24} F_i^B + 91 \times \sum_{i=1}^{24} F_i^C \quad (10-5)$$

Annual volume of domestic water supplied to the fuel cell system (AW) in L (gal)

$$AW = 91 \times \sum_{i=1}^{24} V_{w,i}^A + 183 \times \sum_{i=1}^{24} V_{w,i}^B + 91 \times \sum_{i=1}^{24} V_{w,i}^C \quad (10-6)$$

where the superscripts A, B, and C indicate winter, spring/fall, and summer days, respectively, and the values for E_i , G_i , $Q_{wh,i}$, $Q_{sh,i}$, F_i , and $V_{w,i}$ are determined from equations presented in the following sections for each residential fuel cell system type. Results are reported in the format depicted in Table 10.1.

Table 10.1. Annual energy ratings for residential fuel cell systems

Service	Estimated Annual Requirement for Residence	Annual Energy Supplied by this Unit
Electrical energy supplied to the residence	kW·h	AE kW·h
Electrical energy supplied to the grid	N.A.	AG kW·h
Thermal energy for water heating	kW·h (Btu)	AQ_{wh} kW·h (Btu)
Thermal energy for space heating	kW·h (Btu)	AQ_{sh} kW·h (Btu)
Annual natural gas usage by this unit	N.A.	AF kW·h (therms)
Annual water usage by this unit	N.A.	AW L (gal)

10.2 Rated and annual performance for grid independent, electrical load following Type I RFCS

10.2.1 Rated performance for outdoor Type I RFCS

The rated performance for an outdoor Type I RFCS is defined by the electrical power output, thermal output rate, fuel use rate, and water use rate when the RFCS is operated to yield *maximum continuous power at an ambient temperature of T_H* . The rated values for the energy and mass flow rates are given by:

$$\text{Power in kW:} \quad \dot{E}^R = \dot{E}_{fc} \quad (10-7a)$$

$$\text{Coincident thermal output rate in kW (Btu/h):} \quad \dot{Q}^R = \dot{Q}_{ss} \quad (10-7b)$$

$$\text{Fuel use rate in kW (Btu/h):} \quad \dot{F}^R = \dot{F} \quad (10-7c)$$

$$\text{Water use rate in L/h (gal/h):} \quad \dot{V}_w^R = \dot{V}_w \quad (10-7d)$$

where the energy and mass flow rates are determined as described in Section 9.2 and are averaged over the duration of the steady-state test.

10.2.2 Rated performance for indoor Type I RFCS⁴

The rated performance for an indoor Type I RFCS is defined by the electrical power output, thermal output rate, fuel use rate, ventilation airflow rate (if indoor air is used for ventilation), and water use rate when the RFCS is operated to yield *maximum power at an ambient temperature of T_I* . The rated values for the energy and mass flow rates are given by:

⁴ Variables associated with indoor systems are designated with an asterisk to distinguish them from similarly defined variables for systems located outdoors.

Power in kW: $\dot{E}^{R*} = \dot{E}_{fc}$ (10-8a)

Coincident thermal output rate in kW (Btu/h): $\dot{Q}^{R*} = \dot{Q}_{ss}$ (10-8b)

Fuel use rate in kW (Btu/h): $\dot{F}^{R*} = \dot{F}$ (10-8c)

Water use rate in L/h (gal/h): $\dot{V}_w^{R*} = \dot{V}_w$ (10-8d)

Ventilation airflow rate (if from indoors) in kg/h (lb_m/h): $\dot{m}_a^{R*} = \dot{m}_a$ (10-8e)

where the energy and mass flow rates are determined as described in Section 9.2 and are averaged over the duration of the steady-state test.

10.2.3 Part-load performance evaluation for a Type I RFCS

10.2.3.1 Overview of part-load performance evaluation

The annual rating procedure for a Type I RFCS, described in Section 10.2.5, requires part-load factors that relate performance to ambient temperature and electrical part-load ratio, r_e , which is defined as:

$$r_e = \frac{E_{fc}}{\dot{E}^R \times 1 \text{ h}} \quad (10-9)$$

For a Type I RFCS, part-load factors expressed as polynomials that are first-order in ambient temperature, T_a , and second-order in part-load ratio, r_e , are defined for the fuel use rate (X_f), thermal output rate (X_q), ventilation airflow rate (X_a), and water use rate (X_w).

The coefficients for each part-load factor polynomial are determined by linear regression using data from the six steady-state tests specified in Table 10.2. For each test the system is operated to yield the specified electrical part load ratio, r_e . The environmental chamber is operated to maintain the specified ambient temperature which is T_H or T_L for outdoor units and T_I for indoor units. Based on the recorded data, results are calculated for the power, thermal output rate, fuel flow rate, ventilation airflow rate, and water use rate as specified in Section 9.2. These quantities along with ambient temperature are averaged over the duration of the steady-state test. Based on these results and the rated values, the average electrical part-load ratio and the part-load factors for the fuel use rate, thermal output rate ventilation airflow rate, and water use rate are determined. The procedure is illustrated in Table 10.2. Data from the final six columns of Table 10.2 are used in the linear regressions to determine the coefficients for the polynomial functions. The definition, functional form, and application of each part-load factor are presented in the text following the table.

In addition, transient electrical load correction factors for fuel use, K_{tf} , and thermal output, K_{tq} , are determined in accordance with Eqs. 9-18 and 9-19, respectively, at T_H and T_L for outdoor units and at T_I for indoor units.

Table 10.2. Procedure for determining part-load factors for energy and mass flow rates as functions of electrical part-load ratio and ambient temperature.

Test conditions			Calculated results										
	r_e	T_a	Mass and energy flows ¹					Part load factors				Independent variables	
			\dot{E}_{fc}	\dot{Q}_{fc}	\dot{F}	\dot{m}_a^3	\dot{V}_w	X_f	X_q	X_w	X_a	r_e	T_a
Outdoor RFCFS	1.0	T_H											
	Midpt	T_H											
	Min ²	T_H	Eq. (9-2)	Eq. (9-3)	Eq. (9-1)	N.A.	Eq. (9-15)	Eq. (10-10)	Eq. (10-13)	Eq. (10-16)	N.A.	Note 1	Note 1
	1.0	T_L											
Indoor RFCFS	1.0	T_L											
	Midpt	T_L											
	Min ²	T_L	Eq. (9-2)	Eq. (9-3)	Eq. (9-1)	Eq. (9-10)	Eq. (9-15)	Eq. (10-10)	Eq. (10-13)	Eq. (10-16)	Eq. (10-22)	Note 1	Note 1

Notes: 1. Quantities are averaged over the duration of the steady state test.

2. Minimum fuel cell output is defined by the manufacturer.

3. Ventilation airflow rate is determined for units that draw air from indoors.

10.2.3.2 Part-load factors for outdoor Type I RFCFS

Part-load fuel use factor. The part-load fuel use factor, X_f , is the fraction of the rated fuel use rate at the conditions of electrical part load ratio, r_e , and system ambient temperature T_a :

$$X_f \equiv \frac{\dot{F}(r_e, T_a)}{\dot{F}^R} \quad (10-10)$$


The functional form of X_f is:

$$X_f(r_e, T_a) = a_1 + a_2 r_e + a_3 r_e^2 + a_4 r_e T_a + a_5 r_e^2 T_a + a_6 T_a \quad (10-11)$$

where the coefficients are determined by linear regression of the steady state test data. Representative functions for the part-load fuel use factor are illustrated in Figure 10.1.

The part-load fuel use factor is used in the annual performance rating procedure to determine the fuel use, \dot{F} , in kW (Btu/h) as a function of the electrical power and ambient temperature according to:

$$\dot{F} = X_f(r_e, T_a) \times \dot{F}^R \quad (10-12)$$

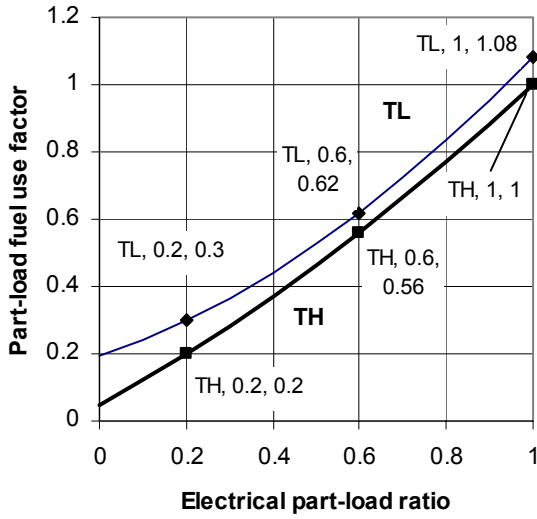


$$X_f(r_e, T_a) = a_1 + a_2 r_e + a_3 r_e^2 + a_4 r_e T_a + a_5 r_e^2 T_a + a_6 T_a$$

$$a_1 = 0.2994 \quad a_2 = 0.2625 \quad a_3 = 0.5781$$

$$a_4 = 0.0125 \quad a_5 = -0.00938 \quad a_6 = -0.00713$$

Figure 10.1. Representative function for part-load fuel use factor

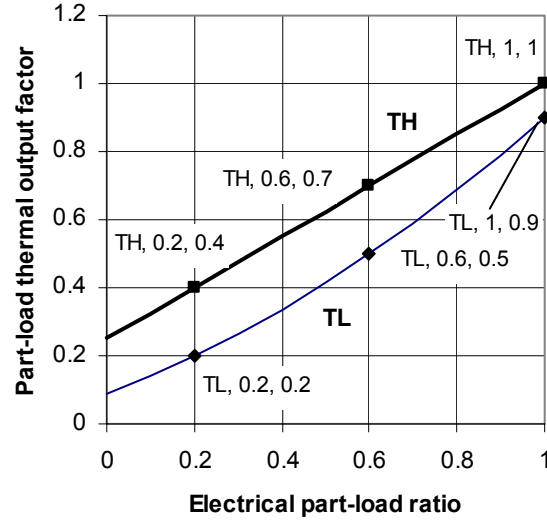

$$X_q(r_e, T_a) = b_1 + b_2 r_e + b_3 r_e^2 + b_4 r_e T_a + b_5 r_e^2 T_a + b_6 T_a$$

$$b_1 = -0.03438 \quad b_2 = 0.3125 \quad b_3 = 0.5469$$

$$b_4 = 0.0125 \quad b_5 = -0.01563 \quad b_6 = 0.008125$$

Figure 10.2. Representative function for part-load thermal output factor

Part-load thermal output factor. The part-load thermal output factor, X_q , is the fraction of the rated thermal output rate at the conditions of electrical part load ratio, r_e , and system ambient temperature T_a :

$$X_q \equiv \frac{\dot{Q}_{fc}(r_e, T_a)}{\dot{Q}^R} \quad (10-13)$$

The functional form of X_q is:

$$X_q(r_e, T_a) = b_1 + b_2 r_e + b_3 r_e^2 + b_4 r_e T_a + b_5 r_e^2 T_a + b_6 T_a \quad (10-14)$$

where the coefficients are determined by linear regression of the steady state test data. Representative functions for the part-load thermal output factor are illustrated in Figure 10.2.

The part-load thermal output factor is used in the annual performance rating procedure to determine the thermal output rate, \dot{Q}_{fc} , in kW (Btu/h) as a function of the electrical power and ambient temperature according to:

$$\dot{Q}_{fc} = X_q(r_e, T_a) \dot{Q}^R \quad (10-15)$$

Part-load water use factor. The part-load water use factor, X_w , is the fraction of the rated water flow rate required at the conditions of electrical part load ratio, r_e , and system ambient temperature T_a :

$$X_w \equiv \frac{\dot{V}_w(r_e, T_a)}{\dot{V}_w^R} \quad (10-16)$$

The functional form of X_w is:

$$X_w(r_e, T_a) = c_1 + c_2 r_e + c_3 r_e^2 + c_4 r_e T_a + c_5 r_e^2 T_a + c_6 T_a \quad (10-17)$$

where the coefficients are determined by linear regression of the steady state test data. Representative functions for the part-load thermal output factor are illustrated in Figure 10.3.

The part-load water use factor is used in the annual performance rating procedure to determine the water use rate, \dot{V}_w , in L/h (gal/h) as a function of the electrical power and ambient temperature according to:

$$\dot{V}_w = X_w(r_e, T_a) \dot{V}_{fw}^R \quad (10-18)$$

10.2.3.3 Part-load factors for indoor Type I RFCS

The part-load factors for an indoor Type I RFCS are defined and applied in the same way as those for outdoor units except there is no functional dependence on ambient temperature because it is assumed to remain constant at a value of T_I . Thus the forms for the part-load functions are simplified to:

$$X_f^*(r_e) = a_1^* + a_2^* r_e + a_3^* r_e^2 \quad (10-19)$$

$$X_q^*(r_e) = b_1^* + b_2^* r_e + b_3^* r_e^2 \quad (10-20)$$

$$X_w^*(r_e) = c_1^* + c_2^* r_e + c_3^* r_e^2 \quad (10-21)$$

In addition, if the RFCS draws ventilation air from the residence, it imposes air conditioning and heating loads. To model these loads, a part-load ventilation airflow factor is defined for units that draw ventilation air from the residence. The part-load ventilation airflow factor, X_a , is the fraction of the rated ventilation airflow required at the conditions of electrical part load ratio, r_e , and system ambient temperature T_I :

$$X_a^* \equiv \frac{\dot{m}_a^*(r_e)}{\dot{m}_a^{R*}} \quad \text{for } T_a = T_I \quad (10-22)$$


The functional form of X_a is:

$$X_a^*(r_e) = d_1^* + d_2^* r_e + d_3^* r_e^2 \quad (10-23)$$

where the coefficients are determined by linear regression of the steady state test data. Representative functions for the part-load thermal output factor are illustrated in Figure 10.4.

The part-load ventilation airflow factor is used in the annual performance rating procedure to determine the ventilation airflow rate, \dot{m}_a^* , in kg/h (lb_m/h) as a function of the electrical part-load ratio:

$$\dot{m}_a^* = X_a^*(r_e) \dot{m}_a^{R*} \quad (10-24)$$

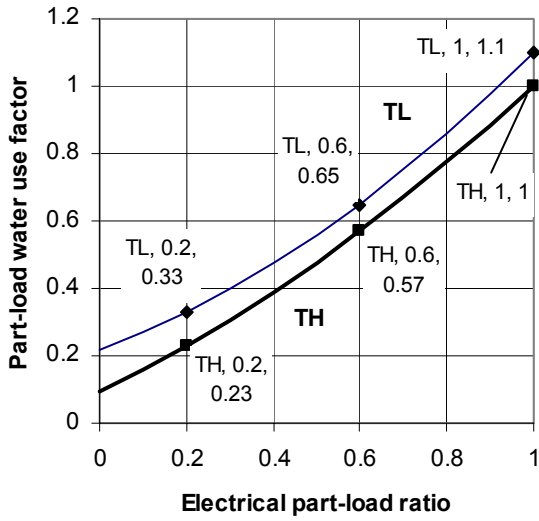


$$X_f(r_e, T_a) = c_1 + c_2 r_e + c_3 r_e^2 + c_4 r_e T_a + c_5 r_e^2 T_a + c_6 T_a$$

$$c_1 = 0.3125 \quad c_2 = 0.3625 \quad c_3 = 0.5000$$

$$c_4 = 0.00750 \quad c_5 = -0.00625 \quad c_6 = -0.00625$$

Figure 10.3. Representative function for part-load water use factor

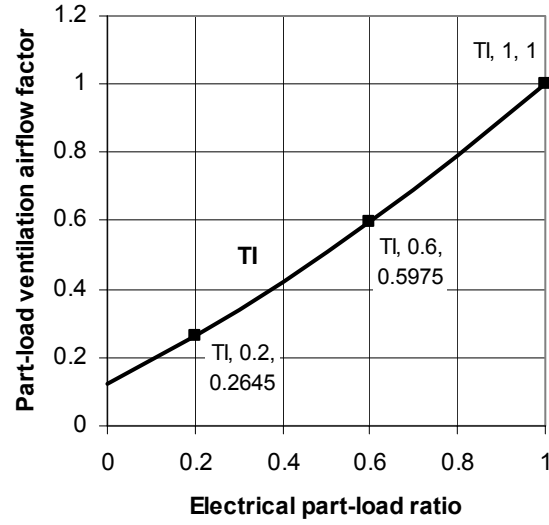

$$X_a^*(r_e) = d_1^* + d_2^* r_e + d_3^* r_e^2$$

$$d_1^* = 0.1241 \quad d_2^* = 0.6588 \quad d_3^* = 0.2172$$

Figure 10.4. Representative function for part-load ventilation airflow factor

10.2.4 Analysis of Simulated Use Data for Type I RFCS

10.2.4.1 Hot water simulated use data for outdoor Type I RFCS

For an outdoor Type I RFCS, the thermal energy provided for water heating is a function of the hot water load, the electrical part load ratio, and the outdoor temperature. Thus, the hot water simulated use tests are conducted at combinations of ambient temperature and electrical part load ratio as specified in Table 7.1. The thermal energy for water heating for each hour, $Q_{wh,i}$, in kW·h (Btu) is found from:

$$Q_{wh,i} = \int_{t=t_{i-1}}^{t=t_i} \dot{Q}_{wh}(r_e, T_a) dt \quad (10-25)$$

where:

\dot{Q}_{wh} is the thermal output rate evaluated from Eq. 9-4 at the indicated values of power and ambient temperature, kW (Btu/h)

Using this data, expressions are determined for the thermal energy provided for each hour as a function of the electrical part load ratio and the ambient temperature:

$$Q_{wh,i} = u_{1i} + u_{2i} T_a + u_{3i} r_e + u_{4i} r_e T_a \quad (10-26)$$

where the coefficients u_{1i} , u_{2i} , u_{3i} , and u_{4i} are determined by linear regression for each hour i of the simulated-use test.

The average thermal loss, $\dot{Q}_{\text{loss,L}}$ and $\dot{Q}_{\text{loss,H}}$, are quantities of thermal power produced by the fuel cell unit during the hot water simulated use tests at ambient temperatures T_L and T_H , respectively, that cannot be supplied as useful heat. They are calculated over the hot water simulated use test as:

$$\dot{Q}_{\text{loss,L}} = \frac{1}{\tau} \int_{t=t_{i-1}}^{t=t_i} \dot{Q}_{\text{loss}}(T_L) dt \quad (10-27)$$

$$\dot{Q}_{\text{loss,H}} = \frac{1}{\tau} \int_{t=t_{i-1}}^{t=t_i} \dot{Q}_{\text{loss}}(T_H) dt \quad (10-28)$$

where:

\dot{Q}_{loss} is the thermal loss rate evaluated from Eq. 9-5 at the indicated value of ambient temperature.

10.2.4.2 Hot water simulated use data for indoor Type I RFCS

For an indoor Type I RFCS, the thermal energy provided for water heating is a function of the hot water load and the electrical part load ratio with the ambient temperature remaining constant at a value of T_I . Thus, the hot water simulated use tests are conducted at ambient temperature T_I and at values of electrical part load ratio as specified in Table 7.1. The thermal energy for water heating for each hour, $Q_{\text{wh},i}$, in kW·h (Btu) is found from:

$$Q_{\text{wh},i}^* = \int_{t=t_{i-1}}^{t=t_i} \dot{Q}_{\text{wh}}(r_e, T_I) dt \quad (10-29)$$

where:

\dot{Q}_{wh} is the thermal output rate evaluated from Eq. 9-4 at the indicated values of power and ambient temperature, kW (Btu/h)

Using this data, expressions are determined for the thermal energy provided for each hour as a function of the electrical part load ratio:

$$Q_{\text{wh},i}^* = u_{1i}^* + u_{2i}^* r_e \quad (10-30)$$

where the coefficients u_{1i}^* and u_{2i}^* are determined for each hour i of the hot water simulated-use test.

The average thermal loss, \dot{Q}_{loss}^* , in kW (Btu/h) is thermal power produced by the fuel cell unit that cannot be supplied as useful heat. It is calculated over the hot water simulated use test as:

$$\dot{Q}_{\text{loss}}^* = \frac{1}{\tau} \int_{t=t_{i-1}}^{t=t_i} \dot{Q}_{\text{loss}}(T_I) dt \quad (10-31)$$

where:

\dot{Q}_{loss} is the thermal loss rate evaluated from Eq. 9-5 at the indoor ambient temperature, T_I .

10.2.5 Annual Performance Rating Procedure for Type I RFCS

10.2.5.1 Overview of rating procedure

Using the procedure described in Section 10.2.2, steady-state test results can be used to describe the fuel use rate, thermal output rate, ventilation airflow rate, and water used rate of a RFCS as functions of the electrical part load ratio and the ambient temperature. The approach described in Section 10.2.3 can be used to establish functions that describe the performance of a RFCS (in combination with a preheat tank) during each hour of a hot water simulated use test. This section describes how the steady-state functions and the hour-by-hour results for the hot water simulated use test can be combined to simulate the annual performance of a Type I RFCS.

10.2.5.2 Rating procedure for outdoor Type I RFCS

The net electrical energy supplied by the RFCS, E_i , in kW·h is given by:

$$E_i = \min(\dot{E}^R \times 1 \text{ h}, E_{L,i}) \quad (10-32)$$

where \dot{E}^R was defined previously and:

$E_{L,i}$ is the electrical energy requirement of the residence during hour i , kW·h

The electrical energy output is used to determine an electrical part load ratio, $r_{e,i}$:

$$r_{e,i} = \frac{E_i}{\dot{E}^R \times 1 \text{ h}} \quad (10-33)$$

The fuel use, thermal energy supplied by the fuel cell, thermal energy applied to water heating, and water use are determined by this electrical part load ratio, the ambient temperature for the hour, $T_{a,i}$, and the appropriate transient electrical load correction factors:

$$F_i = X_f(r_{e,i}, T_{a,i}) \times \dot{F}^R \times \left[\frac{(T_{a,i} - T_L)}{T_H - T_L} (K_{tf}(T_H) - K_{tf}(T_L)) + K_{tf}(T_L) \right] \times 1 \text{ h} \quad (10-34)$$

$$Q_{\text{loss},i} = \left[\dot{Q}_{\text{loss},H} + (\dot{Q}_{\text{loss},L} - \dot{Q}_{\text{loss},H}) \times \frac{T_{a,i} - T_H}{T_L - T_H} \right] \times 1 \text{ h} \quad (10-35)$$

$$Q_{\text{fc},i} = X_q(r_{e,i}, T_{a,i}) \times \dot{Q}^R \times \left[\frac{(T_{a,i} - T_L)}{T_H - T_L} (K_{tq}(T_H) - K_{tq}(T_L)) + K_{tq}(T_L) \right] \times 1 \text{ h} \quad (10-36)$$

$$Q_{\text{wh},i} = u_{1i} + u_{2i} T_{a,i} + u_{3i} r_{e,i} + u_{4i} r_{e,i} T_{a,i} \quad (10-37)$$

$$V_w = X_w(r_{e,i}, T_{a,i}) \times \dot{V}_{\text{fw}}^R \times 1 \text{ h} \quad (10-38)$$

where variables are as previously defined and:

F_i is the fuel use during hour i , kW·h (Btu)

$Q_{fc,i}$ the thermal energy provided by the fuel cell for water heating and space heating during hour i , kW·h (Btu)

$Q_{wh,i}$ the thermal energy provided for water heating during hour i , kW·h (Btu)

$V_{w,i}$ total volume of water used for hour i , L (gal)

The thermal energy used for heating water and the thermal loss between the fuel cell and the preheat tank are subtracted from the RFCS thermal output, $Q_{fc,i}$, to determine the thermal energy available for space heating, $Q_{av,i}$ in kW·h (Btu):

$$Q_{av,i} = Q_{fc,i} - Q_{wh,i} - Q_{loss,i} \quad (10-39)$$

The net contribution of the RFCS to space heating is the minimum of the available thermal energy and the space heating load, $Q_{Ls,i}$ in kW·h (Btu):

$$Q_{sh,i} = \min(Q_{av,i}, Q_{Ls,i}) \quad (10-40)$$

Annual results are summed over each representative day, weighted by the number of occurrences of each representative day, and reported in the format described in Section 10.1.

10.2.5.3 Rating procedure for indoor Type I RFCS

For indoor Type I RFCS, a first approximation to the electrical energy supplied by the fuel cell for each hour, $E_{l,i}$, in kW·h is the minimum of the fuel cell rated power applied over the entire hour or the electrical energy requirement of the residence:

$$E_{l,i} = \min(\dot{E}^R \times 1 \text{ h}, E_{L,i}) \quad (10-41)$$

If the RFCS uses indoor air for ventilation, this first approximation must be corrected to reflect the increase in electrical energy required by the residence due to cooling and dehumidification of the ventilation air required by the RFCS. The quantity of air is determined by the first approximation to the part load ratio, $r_{le,i}$:

$$r_{le,i} = \frac{E_{l,i}}{\dot{E}^R \times 1 \text{ h}} \quad (10-42)$$

which is used in conjunction with the ambient temperature for the hour, T_{ai} , to determine the mass of ventilation air, $m_{a,i}$, in kg (lb_m) according to:

$$m_{a,i}^* = X_a(r_{le,i}) \times \dot{m}_a^{R*} \times 1 \text{ h} \quad (10-43)$$

The electrical energy required to condition this air, $\Delta E_{a,i}^*$, in kJ (Btu) is calculated by:

$$\Delta E_{a,i}^* = \max \left\{ m_{a,i}^* [h_{oa} - h_{iac} + h_{cd}(\omega_{oa} - \omega_{iac})] \times \frac{C_1}{COP_{clg}}; 0 \right\} \quad (10-44)$$

where:

h_{oa} is the enthalpy per unit mass of dry air (da) for the outdoor air at hour i , kJ/kg dry air (Btu/lb_m dry air)

h_{iac} is the enthalpy per unit mass of dry air for the indoor air at cooling season conditions of 25 °C (77 °F) and 50 % RH, 50.3 kJ/kg dry air (21.6 Btu/lb_m dry air)

h_{cd} is the enthalpy of the condensate at 25 °C (77 °F), 104.81 kJ/kg (45.1 Btu/lb_m)

ω_{oa} is the humidity ratio of the for the outdoor air at hour i , kg-water/kg-dry air (lb_m water/lb_m dry air)

ω_{iac} is the humidity ratio of the indoor air at cooling season conditions of 25 °C (77 °F) and 50 % RH, 0.00988 kg-water/kg-dry air (0.00988 lb_m water/lb_m dry air)

COP_{clg} is the coefficient of performance for the air conditioning system which is assumed to be 3.5 (corresponding to an EER of 12)

C_1 is a constant for units conversion, 1 kW·h/3600 kJ (kW·h/3413 Btu)

The net electrical energy supplied by the indoor RFCS, E_i^* , in kW·h is given by:

$$E_i^* = \min\left[\left(\dot{E}^{R*} \times 1 \text{ h} - \Delta E_{a,i}^*\right), E_{L,i}\right] \quad (10-45)$$

where the correction, $\Delta E_{a,i}^*$, is zero if the unit does not draw air from the indoors. The remaining mass and energy flows are based on the gross electrical energy output of the indoor RFCS, $E_{gross,i}^*$ in kW·h:

$$E_{gross,i}^* = E_i^* + \Delta E_{a,i}^* \quad (10-46)$$

This gross electrical energy output is used to determine an electrical part load ratio, $r_{e,i}^*$:

$$r_{e,i}^* = \frac{E_{gross,i}^*}{\dot{E}^{R*} \times 1 \text{ h}} \quad (10-47)$$

The fuel use, thermal energy supplied by the fuel cell, thermal energy applied to water heating, and water use are determined by this electrical part load ratio and the appropriate transient electrical load correction factors:

$$F_i^* = X_f^*(r_{e,i}^*) \times \dot{F}^{R*} \times K_{tf} \times 1 \text{ h} \quad (10-48)$$

$$Q_{fc,i}^* = X_q^*(r_{e,i}^*) \times \dot{Q}^{R*} \times K_{tq} \times 1 \text{ h} \quad (10-49)$$

$$Q_{wh,i}^* = u_{li}^* + u_{2i}^* r_{e,i}^* \quad (10-50)$$

$$V_w^* = X_w^*(r_{e,i}^*) \times \dot{V}_{fw}^{R*} \times 1 \text{ h} \quad (10-51)$$

If the indoor RFCS uses ventilation air from indoors, the thermal output must be corrected to reflect the increase in the thermal load of the residence due to the ventilation air required

by the RFCS. The thermal energy required to heat this air, $\Delta Q_{a,i}^*$, in kJ (Btu) is calculated by:

$$\Delta Q_{a,i}^* = \max[m_{a,i}^* c_{pa} (T_{iah} - T_{oa}); 0] \quad (10-52)$$

where the mass of air for hour i, $m_{a,i}^*$, is determined from Eq. 10-43 and:

c_{pa} is the constant pressure specific heat for air at assumed conditions of 5 °C (40°F),

T_{oa} is the temperature of the outdoor air at hour i, °C (°F)

T_{iah} is the temperature of the indoor air at heating conditions which is 21 °C (70 °F)

The thermal energy used for heating water, used for heating ventilation air, and lost in the circulating fluid between the fuel cell and the preheat tank are subtracted from the RFCS thermal output, $Q_{fc,i}^*$, to determine the thermal energy available for space heating, $Q_{av,i}^*$, in kW·h (Btu)⁵:

$$Q_{av,i}^* = Q_{fc,i}^* - Q_{wh,i}^* - \Delta Q_{ah,i}^* - Q_{loss} \quad (10-53)$$

where the correction, $\Delta Q_{a,i}^*$, is zero if the unit does not draw air from the indoors. The net contribution of the RFCS to space heating is the minimum of the available thermal energy and the space heating load:

$$Q_{sh,i}^* = \min(Q_{av,i}^*, Q_{Ls,i}) \quad (10-54)$$

Annual results are summed over each representative day, weighted by the number of occurrences of each representative day, and reported in the format described in Section 10.1.

⁵ Note that the available thermal energy may actually be negative if the thermal energy remaining after water heating is not sufficient to heat the ventilation air.

10.3 Rated and annual performance for grid interconnected, constant power Type II RFCS

10.3.1 Rated performance for outdoor Type II RFCS

The RFCS is operated to yield the *power or thermal output rate specified by the manufacturer at an ambient temperature of T_H* . The rated values for the energy and mass flow rates are given by:

$$\text{Power in kW:} \quad \dot{E}^R = \dot{E}_{fc} \quad (10-55a)$$

$$\text{Coincident thermal output rate in kW (Btu/h):} \quad \dot{Q}^R = \dot{Q}_{ss} \quad (10-55b)$$

$$\text{Fuel use rate in kW (Btu/h):} \quad \dot{F}^R = \dot{F} \quad (10-55c)$$

$$\text{Water use rate in L/h (gal/h):} \quad \dot{V}_w^R = \dot{V}_w \quad (10-55d)$$

where the energy and mass flow rates are determined as described in Section 9.2 and are averaged over a one-hour steady-state test.

10.3.2 Rated performance for indoor Type II RFCS

The RFCS is operated to yield the *power or thermal output rate specified by the manufacturer at an ambient temperature of T_I for indoor units*. The rated values for the energy and mass flow rates are given by:

$$\text{Power in kW:} \quad \dot{E}^{R*} = \dot{E}_{fc} \quad (10-56a)$$

$$\text{Coincident thermal output rate in kW (Btu/h):} \quad \dot{Q}^{R*} = \dot{Q}_{ss} \quad (10-56b)$$

$$\text{Fuel use rate in kW (Btu/h):} \quad \dot{F}^{R*} = \dot{F} \quad (10-56c)$$

$$\text{Water use rate in L/h (gal/h):} \quad \dot{V}_w^{R*} = \dot{V}_w \quad (10-56d)$$

$$\text{Ventilation airflow rate (if from indoors) in kg/h (lb}_m\text{/h):} \quad \dot{m}_a^{R*} = \dot{m}_a^{on} \quad (10-56e)$$

where the energy and mass flow rates are determined as described in Section 9.2 and are averaged over a one-hour steady-state test.

10.3.3 Fuel use, thermal output, ventilation airflow, and water use rates as functions of ambient temperature for Type II RFCS

10.3.3.1 Overview of part-load performance evaluation

The annual rating procedure, described in Section 10.3.5, requires that the fuel use rate, thermal output rate, water use, and ventilation airflow rate (for indoor units drawing air from indoors) be estimated at the appropriate ambient temperature (outdoor or indoor temperature depending on location of the system). For outdoor units, system performance is determined at two temperatures with the performance at other temperatures estimated by interpolation. For indoor units the Type II system always performs at rated conditions.

10.3.3.2 Part-load factors for outdoor Type II RFCS

For an outdoor Type II RFCS, the annual rating procedure, described in Section 10.3.5, requires that the fuel use rate, thermal output rate, and water use rate be determined at

ambient temperatures of T_H and T_L . The values at a particular ambient temperature are then estimated based on interpolation between the results at T_H and those at T_L .

Fuel use. The average hourly fuel use values at T_H and T_L , respectively, are given by:

$$F_H = \frac{1}{\tau} \int_{t=0}^{t=\tau} \dot{F}(\dot{E}^R, T_H) dt \quad (10-57a)$$

$$F_L = \frac{1}{\tau} \int_{t=0}^{t=\tau} \dot{F}(\dot{E}^R, T_L) dt \quad (10-57b)$$

where:

τ is the duration of the steady state test, h

\dot{F} is the fuel use rate evaluated from Eq. 9-1 at the indicated values of power and ambient temperature, kW (Btu/h)

F_H is the average hourly fuel use at ambient temperature T_H , kW·h (Btu)

F_L is the average hourly fuel use at ambient temperature T_L , kW·h (Btu)

Thermal output. The average hourly thermal output values at T_H and T_L , respectively, are given by:

$$Q_{fc,H} = \frac{1}{\tau} \int_{t=0}^{t=\tau} \dot{Q}_{fc}(\dot{E}^R, T_H) dt \quad (10-58a)$$

$$Q_{fc,L} = \frac{1}{\tau} \int_{t=0}^{t=\tau} \dot{Q}_{fc}(\dot{E}^R, T_L) dt \quad (10-58b)$$

where:

\dot{Q}_{fc} is the thermal output rate evaluated from Eq. 9-3 at the indicated values of power and ambient temperature, kW (Btu/h)

$Q_{fc,H}$ is the average hourly thermal output at ambient temperature T_H , kW·h (Btu)

$Q_{fc,L}$ is the average hourly thermal output at ambient temperature T_L , kW·h (Btu)

Water use. The average hourly water use quantities at T_H and T_L , respectively, are given by:

$$V_{w,H} = \frac{1}{\tau} \int_{t=0}^{t=\tau} \dot{V}_w(\dot{E}^R, T_H) dt \quad (10-59a)$$

$$V_{w,L} = \frac{1}{\tau} \int_{t=0}^{t=\tau} \dot{V}_w(\dot{E}^R, T_L) dt \quad (10-59b)$$

where:

\dot{V}_w is the water use rate from Eq. 9-15 at the indicated values of power and ambient temperature, L/h (gal/h)

$V_{w,H}$ is the average hourly water use quantity at ambient temperature T_H , kg (lb_m)

$V_{w,L}$ is the average hourly water use quantity at ambient temperature T_L , kg (lb_m)

10.3.3.3 Indoor Type II RFCS

For an indoor Type II RFCS, the annual rating procedure, described in Section 10.3.5, assumes that the unit always operates at rated power, fuel use rate, thermal output rate, ventilation airflow rate (for units drawing air from indoors), and water use rate.

10.3.4 Analysis of Simulated Use Data for Type II RFCS

10.3.4.1 Hot water simulated use data for outdoor Type II RFCS

For an outdoor Type II RFCS, the thermal energy provided by the RFCS is determined for each hour of a hot water simulated use test performed at ambient temperatures of T_H and T_L . In the rating procedure of Section 10.4, the values at a particular ambient temperature are estimated based on interpolation between the results at T_H and those at T_L . Hourly values in kW·h (Btu) for thermal energy provided by the RFCS/preheat tank at T_H and T_L , respectively, are given by:

$$Q_{whH,i} = \int_{t=t_{i-1}}^{t=t_i} \dot{Q}_{wh}(\dot{E}^R, T_H) dt \quad (10-60a)$$

$$Q_{whL,i} = \int_{t=t_{i-1}}^{t=t_i} \dot{Q}_{wh}(\dot{E}^R, T_L) dt \quad (10-60b)$$

where:

\dot{Q}_{wh} is the thermal output rate evaluated from Eq. 9-4 at the indicated values of power and ambient temperature, kW (Btu/h)

$Q_{whH,i}$ is the thermal energy provided by the RFCS/preheat tank during hour i at ambient temperature T_H , kW·h (Btu)

$Q_{whL,i}$ is the thermal energy provided by the RFCS/preheat tank during hour i at ambient temperature T_L , kW·h (Btu)

The average thermal loss, $\dot{Q}_{loss,L}$ and $\dot{Q}_{loss,H}$, are quantities of thermal power produced by the fuel cell unit during the hot water simulated use tests at ambient temperatures T_L and T_H , respectively, that cannot be supplied as useful heat. They are calculated over the hot water simulated use test as:

$$\dot{Q}_{loss,L} = \frac{1}{\tau} \int_{t=t_{i-1}}^{t=t_i} \dot{Q}_{loss}(T_L) dt \quad (10-61a)$$

$$\dot{Q}_{loss,H} = \frac{1}{\tau} \int_{t=t_{i-1}}^{t=t_i} \dot{Q}_{loss}(T_H) dt \quad (10-61b)$$

where:

\dot{Q}_{loss} is the thermal loss rate evaluated from Eq. 9-5 at the indicated value of ambient temperature.

10.3.4.2 Hot water simulated use data for indoor Type II RFCS

The thermal energy provided by an indoor Type II RFCS system to the domestic water heating system of the residence during hour i is given by:

$$Q_{wh,i}^* = \int_{t=t_{i-1}}^{t=t_i} \dot{Q}_{wh}(\dot{E}^R, T_I) dt \quad (10-62)$$

where $\dot{Q}_{wh}(\dot{E}^R, T_I)$ is determined in accordance with Eq. (9-4) using data from a hot water simulated use test conducted at rated power and at ambient temperature T_I .

The average thermal loss, \dot{Q}_{loss}^* , in kW (Btu/h) is thermal power produced by the fuel cell unit that cannot be supplied as useful heat. It is calculated over the hot water simulated use test as:

$$\dot{Q}_{loss}^* = \frac{1}{\tau} \int_{t=t_{i-1}}^{t=t_i} \dot{Q}_{loss}(T_I) dt \quad (10-63)$$

Where \dot{Q}_{loss} is the thermal loss rate evaluated from Eq. 9-5 at the indoor ambient temperature, T_I .

10.3.5 Annual Performance Rating Procedure

10.3.5.1 Overview of rating procedure

Using the procedure described in the Section 10.3.2, steady-state test results can be used to determine average hourly values for the fuel use rate, thermal output rate, ventilation airflow rate, and water used rate of a Type II RFCS at specific values of the ambient temperature (T_I for indoor units and both T_H and T_L for outdoor units). The approach described in Section 10.3.3 can be used to determine the performance of a Type II RFCS (in combination with a preheat tank) during each hour of a hot water simulated use test at specific values of the ambient temperature (T_I for indoor units and both T_H and T_L for outdoor units). This section describes how the steady-state functions and the hour-by-hour results for the hot water simulated use test can be combined to determine the annual performance of a Type II RFCS.

10.3.5.2 Rating procedure for outdoor Type II RFCS

In grid interconnected, constant power mode, the electrical energy supplied by the Type II RFCS for each hour, i , is always the same and corresponds to the rated power of the fuel cell applied over the entire hour. The portion of the net electrical energy that is used by the residence, E_i , in kW·h is the minimum of the net energy available from the RFCS operating at rated power, \dot{E}^R , and the electrical energy requirement of the residence:

$$E_i = \min(\dot{E}^R \times 1 \text{ h}, E_{L,i}) \quad (10-64)$$

The remaining power (if any), G_i , in kW·h is supplied to the electrical grid:

$$G_i = \dot{E}^R \times 1 \text{ h} - E_i \quad (10-65)$$

For outdoor units, the fuel use, thermal energy supplied by the fuel cell, thermal energy applied to water heating, and water use are determined by using the ambient temperature for each hour, $T_{a,i}$, to interpolate between the results from the steady-state and simulated

use tests conducted at high (T_H) and low (T_L) ambient temperatures and at the rated power output:

$$F_i = F_H + (F_L - F_H) \times \frac{T_{a,i} - T_H}{T_L - T_H} \quad (10-66)$$

$$Q_{\text{loss},i} = \dot{Q}_{\text{loss},H} + (\dot{Q}_{\text{loss},L} - \dot{Q}_{\text{loss},H}) \times \frac{T_{a,i} - T_H}{T_L - T_H} \times 1 \text{ h} \quad (10-67)$$

$$Q_{\text{fc},i} = Q_{\text{fc},H} + (Q_{\text{fc},L} - Q_{\text{fc},H}) \times \frac{T_{a,i} - T_H}{T_L - T_H} \quad (10-68)$$

$$Q_{\text{wh},i} = Q_{\text{wh},H} + (Q_{\text{wh},L} - Q_{\text{wh},H}) \times \frac{T_{a,i} - T_H}{T_L - T_H} \quad (10-69)$$

$$V_{w,i} = V_{w,H} + (V_{w,L} - V_{w,H}) \times \frac{T_{a,i} - T_H}{T_L - T_H} \quad (10-70)$$

The thermal energy used for heating water is subtracted from the rated RFCS thermal output, $Q_{\text{fc},i}$, to determine the thermal energy available for space heating, $Q_{\text{av},i}$, in kWh (Btu):

$$Q_{\text{av},i} = Q_{\text{fc},i} - Q_{\text{wh},i} - Q_{\text{loss},i} \quad (10-71)$$

The net contribution of an outdoor Type II RFCS to space heating, $Q_{\text{sh},i}$, in kW·h (Btu) is the minimum of the available thermal energy and the space heating load:

$$Q_{\text{sh},i} = \min(Q_{\text{av},i}, Q_{\text{LS},i}) \quad (10-72)$$

Annual results are summed over each representative day, weighted by the number of occurrences of each representative day, and reported in the format described in Section 10.1.

10.3.5.3 Rating procedure for indoor Type II RFCS

In grid interconnected, constant power mode, the electrical energy supplied by the Type II RFCS for each hour, i , is always the same and corresponds to the rated power of the fuel cell applied over the entire hour. For units drawing ventilation air from indoors, the net electrical energy must be reduced to reflect the energy used to condition the ventilation air. The ventilation airflow rate at rated power, \dot{m}_a^R , is determined during the rating test. The electrical energy required to condition this air, $\Delta E_{a,i}$, in kJ (Btu) is calculated by:

$$\Delta E_{a,i}^* = \max \left\{ \dot{m}_a^R \times 1 \text{ h} \times [h_{\text{oa}} - h_{\text{iac}} + h_{\text{cd}} (\omega_{\text{oa}} - \omega_{\text{iac}})] \times \frac{C_1}{\text{COP}_{\text{clg}}}; 0 \right\} \quad (10-73)$$

where:

h_{oa} is the enthalpy per unit mass of dry air (da) for the outdoor air at hour i , kJ/kg-da (Btu/lb_m-da)

h_{iac} is the enthalpy per unit mass of dry air for the indoor air at cooling season conditions of 25 °C (77 °F) and 50 % RH, 50.3 kJ/kg dry air (21.6 Btu/lb_m dry air)

h_{cd} is the enthalpy of the condensate at 25 °C (77 °F), 104.81 kJ/kg (45.1 Btu/lb_m)

ω_{oa} is the humidity ratio of the for the outdoor air at hour i, kg-water/kg dry air (lb_m water/lb_m dry air)

ω_{iac} is the humidity ratio of the indoor air at cooling season conditions of 25 °C (77°F) and 50 % RH, 0.00988 kg-water/kg dry air (0.00988 lb_m water/lb_m dry air)

COP_{clg} is the coefficient of performance for the air conditioning system which is assumed to be 3.5 (corresponding to an EER of 12)

C_1 is a constant for units conversion, 1 kW·h/3600 kJ (kWh/3413 Btu)

The portion of the net electrical energy that is used by the residence is the minimum of the net energy available from the RFCS (after correcting for the electrical energy to condition ventilation air) and the electrical energy requirement of the residence:

$$E_i^* = \min \left[\left(\dot{E}^{R*} \times 1 \text{ h} - \Delta E_{a,i}^* \right), E_{L,i} \right] \quad (10-74)$$

where the correction, ΔE_{ai} , is zero if the unit does not draw air from the indoors. The remaining electrical energy (if any), G_i^* , in kW·h is supplied to the electrical grid:

$$G_i^* = \left(\dot{E}^{R*} \times 1 \text{ h} - \Delta E_{a,i}^* \right) - E_i^* \quad (10-75)$$

For indoor units, the fuel use, thermal energy supplied by the fuel cell, thermal energy and water use correspond to the rated values:

$$F_i^* = \dot{F}^{R*} \times 1 \text{ h} \quad (10-76)$$

$$Q_{fc,i}^* = \dot{Q}^{R*} \times 1 \text{ h} \quad (10-77)$$

$$V_{w,i}^* = \dot{V}_w^{R*} \times 1 \text{ h} \quad (10-78)$$

The thermal energy applied to water heating for each hour corresponds of the values obtained from the simulated use test conducted at ambient temperature T_L .

$$Q_{wh,i}^* = Q_{wh,i}^* \text{ from Eq. 10-62} \quad (10-79)$$

For indoor units that draw ventilation air from the indoors, the available thermal energy must be reduced by the amount of thermal energy required for heating ventilation air, $\Delta Q_{a,i}$, in kJ (Btu) which is calculated by:

$$\Delta Q_{a,i}^* = \max \left[\dot{m}_a^{R*} \times 1 \text{ h} \times c_{pa} (T_{iah} - T_{oa}), 0 \right] \quad (10-80)$$

where:

c_{pa} is the constant pressure specific heat for air at assumed conditions of 5 °C (40 °F),

T_{oa} is the temperature of the outdoor air at hour i , °C (°F)

T_{iah} is the temperature of the indoor air at heating conditions which is 21 °C (70 °F)

The thermal energy used for heating water and for heating ventilation air is subtracted from the rated RFCS thermal output, $Q_{fc,i}$, to determine the thermal energy available for space heating, $Q_{av,i}^*$, in kW·h (Btu):

$$Q_{av,i}^* = Q_{fc,i} - Q_{wh,i} - \Delta Q_{ah,i} - Q_{loss,i} \quad (10-81)$$

where the correction term, $\Delta Q_{a,i}$, is zero if the unit does not draw air from the indoors. The net contribution of a Type II RFCS to space heating, $Q_{sh,i}^*$, in kW·h (Btu) is the minimum of the available thermal energy and the space heating load:

$$Q_{sh,i}^* = \min(Q_{av,i}^*, Q_{Ls,i}) \quad (10-82)$$

Annual results are summed over each representative day, weighted by the number of occurrences of each representative day, and reported in the format described in Section 10.1.

10.4 Rated and annual performance for grid interconnected, thermal load following Type III RFCS

10.4.1 Rated performance for outdoor Type III RFCS

The RFCS is operated to yield *maximum thermal output at an ambient temperature of T_H* . The rated values for the energy and mass flow rates are given by:

$$\text{Coincident power in kW:} \quad \dot{E}^R = \dot{E}_{fc} \quad (10-83a)$$

$$\text{Thermal output rate in kW (Btu/h):} \quad \dot{Q}^R = \dot{Q}_{ss} \quad (10-83b)$$

$$\text{Fuel use rate in kW (Btu/h):} \quad \dot{F}^R = \dot{F} \quad (10-83c)$$

$$\text{Water use rate in L/h (gal/h):} \quad \dot{V}_w^R = \dot{V}_w \quad (10-83d)$$

where the energy and mass flow rates are determined as described in Section 9.2 and are averaged over the duration of the steady-state test.

10.4.2 Rated performance for Type III RFCS

The RFCS is operated to yield *maximum thermal output at an ambient temperature of T_I for indoor units*. The rated values for the energy and mass flow rates are given by:

$$\text{Coincident power in kW:} \quad \dot{E}^{R*} = \dot{E}_{fc} \quad (10-84a)$$

$$\text{Thermal output rate in kW (Btu/h):} \quad \dot{Q}^{R*} = \dot{Q}_{fc} \quad (10-84b)$$

$$\text{Fuel use rate in kW (Btu/h):} \quad \dot{F}^{R*} = \dot{F} \quad (10-84c)$$

$$\text{Water use rate in L/h (gal/h):} \quad \dot{V}_w^{R*} = \dot{V}_w \quad (10-84d)$$

$$\text{Ventilation airflow rate (if from indoors) in kg/h (lb}_m\text{/h):} \quad \dot{m}_a^{R*} = \dot{m}_a^{\text{on}} \quad (10-84e)$$

where the energy and mass flow rates are determined as described in Section 9.2 and are averaged over the duration of the steady-state test.

10.4.3 Fuel use, thermal output, ventilation airflow, and water use rates as functions of thermal output and ambient temperature for Type III RFCS

10.4.3.1 Overview of part-load performance evaluation

The annual rating procedure for a Type III RFCS, described in Section 10.4.5, requires part-load factors that relate performance to ambient temperature and thermal part-load ratio which is defined as:

$$r_t = \frac{Q_{fc}}{\dot{Q}^R \times 1 \text{ h}} \quad (10-85)$$

For a Type III RFCS, part-load factors expressed as polynomials that are first-order in ambient temperature, T_a , and second-order in thermal part-load ratio, r_t , are defined for the fuel use rate (Z_f), power output (Z_e), ventilation airflow rate (Z_a), and water use rate (Z_w).

The coefficients for each polynomial are determined by linear regression using data from the six steady-state tests specified in Table 10.4. For each test, the system is operated to

yield the specified thermal part load ratio, r_t . The environmental chamber is operated to maintain the specified ambient temperature which is T_H or T_L for outdoor units and T_I for indoor units. Based on the recorded data, results are calculated for the power, thermal output rate, fuel use rate, ventilation airflow rate (for units drawing air from indoors), and water use rate as specified in Section 9.2. These quantities along with the ambient temperature are averaged over the duration of the steady-state test. Based on these results and the rated values, the thermal part-load ratio, and the part-load factors for the power, fuel use rate, ventilation airflow rate, and water use rate are determined. The procedure is illustrated in Table 10.4. Data from the final six columns are used in the linear regressions to determine the coefficients for the polynomial functions. The definition, functional form, and application of each part-load factor are presented in the sections following the table.

Table 10.4. Procedure for determining part load factors for energy and mass flow rates as functions of thermal part-load ratio and ambient temperature for Type III RFCS.

Test conditions			Calculated results											
	r _t	T _a	Mass and energy flows ¹					Part load factors				Independent variables		
			\dot{E}_{fc}	\dot{Q}_{fc}	\dot{F}	\dot{m}_a ³	\dot{V}_w	Z _f	Z _e	Z _w	Z _a	r _t	T _a	
Outdoor RFCS	1.0	T _H												
	Midpt	T _H												
	Min ²	T _H	Eq. (9-2)	Eq. (9-3)	Eq. (9-1)	N.A.	Eq. (9-15)	Eq. (10-86)	Eq. (10-89)	Eq. (10-92)	N.A.	Note 1	Note 1	
	1.0	T _L												
	Midpt	T _L												
	Min ²	T _L												
Indoor RFCS	1.0	T _I												
	Midpt	T _I	Eq. (9-2)	Eq. (9-3)	Eq. (9-1)	Eq. (9-10)	Eq. (9-15)	Eq. (10-86)	Eq. (10-89)	Eq. (10-92)	Eq. (10-98)	Note 1	Note 1	
	Min	T _I												

Notes: 1. Quantities are averaged over the duration of the steady state test.
2. Minimum fuel cell output is defined by the manufacturer.
3. Ventilation airflow rate is determined for units that draw air from indoors.

10.4.3.2 Part-load factors for outdoor Type III RFCS


Part-load fuel use factor. The part-load fuel use factor, Z_f , is the fraction of the rated fuel use rate at the conditions of thermal part load ratio, r_t , and system ambient temperature, T_a :

$$Z_f \equiv \frac{\dot{F}(r_t, T_a)}{\dot{F}^R} \quad (10-86)$$

The functional form of Z_f is:

$$Z_f(r_t, T_a) = e_1 + e_2 r_t + e_3 r_t^2 + e_4 r_t T_a + e_5 r_t^2 T_a + e_6 T_a \quad (10-87)$$

where the coefficients are determined by linear regression of the steady state test data. A representative function for the part-load fuel use factor is illustrated in Figure 10.5.

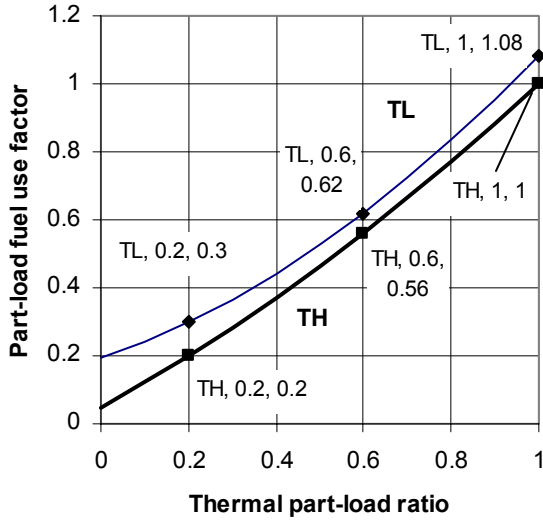


$$Z_f(r_t, T_a) = e_1 + e_2 r_t + e_3 r_t^2 + e_4 r_t T_a + e_5 r_t^2 T_a + e_6 T_a$$

$$e_1 = 0.2994 \quad e_2 = 0.2625 \quad e_3 = 0.5781$$

$$e_4 = 0.0125 \quad e_5 = -0.00938 \quad e_6 = -0.00713$$

Figure 10.5. Representative function for fuel use part-load factor

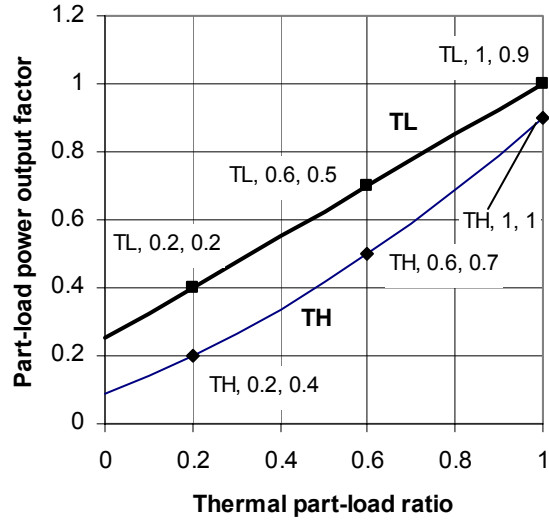

$$Z_e(r_t, T_a) = f_1 + f_2 r_t + f_3 r_t^2 + f_4 r_t T_a + f_5 r_t^2 T_a + f_6 T_a$$

$$f_1 = -0.03438 \quad f_2 = 0.3125 \quad f_3 = 0.5469$$

$$f_4 = 0.0125 \quad f_5 = -0.01563 \quad f_6 = 0.008125$$

Figure 10.6. Representative function for power output part-load factor

The part-load fuel use factor is used in the annual performance rating procedure to determine the fuel use, \dot{F} , in kW (Btu/h) as a function of the electrical power and ambient temperature according to:

$$\dot{F} = Z_f(r_t, T_a) \times \dot{F}^R \quad (10-88)$$

Part-load power output factor. The part-load power output factor Z_e is the fraction of the rated output power at conditions of thermal part load ratio, r_t , and system ambient temperature, T_a :

$$Z_e \equiv \frac{\dot{E}_{fc}(r_t, T_a)}{\dot{E}^R} \quad (10-89)$$

The functional form of Z_e is:

$$Z_e(r_t, T_a) = f_1 + f_2 r_t + f_3 r_t^2 + f_4 r_t T_a + f_5 r_t^2 T_a + f_6 T_a \quad (10-90)$$

where the coefficients are determined by linear regression of the steady state test data. A representative function for the part-load power output factor is illustrated in Figure 10.6.

The part-load power output factor is used in the annual performance rating procedure to determine the power output, \dot{E}_{fc} , in kW as a function of the thermal part-load ratio and the ambient temperature according to:

$$\dot{E}_{fc} = Z_e(r_t, T_a) \dot{E}^R \quad (10-91)$$

Part-load water use factor. The part-load water use factor Z_w is the fraction of the rated water use rate required at the conditions of thermal part load ratio, r_t , and ambient temperature T_a :

$$Z_w \equiv \frac{\dot{V}_w(r_t, T_a)}{\dot{V}_w^R} \quad (10-92)$$

The functional form of Z_w is:

$$Z_w(r_t, T_a) = g_1 + g_2 r_t + g_3 r_t^2 + g_4 r_t T_a + g_5 r_t^2 T_a + g_6 T_a \quad (10-93)$$

where the coefficients are determined by linear regression of the steady state test data. A representative function for the part-load water use factor is illustrated in Figure 10.7.

The part-load water use factor is used in the annual performance rating procedure to determine the water use, \dot{V}_w , in L/h (gal/h) as a function of the thermal part-load ratio and the ambient temperature according to:

$$\dot{V}_w = Z_w(r_t, T_a) \dot{V}_w^R \quad (10-94)$$

10.4.3.3 Part-load factors for indoor Type III RFCS

The part-load factors for an indoor Type III RFCS are defined and applied in the same way as those for an outdoor unit except there is no functional dependence on ambient temperature because it is assumed to remain constant at a value of T_I . Thus the forms for the part-load functions are simplified to:

$$Z_f^*(r_t) = e_1^* + e_2^* r_t + e_3^* r_t^2 \quad (10-95)$$

$$Z_e^*(r_t) = f_1^* + f_2^* r_t + f_3^* r_t^2 \quad (10-96)$$

$$Z_w^*(r_t) = g_1^* + g_2^* r_t + g_3^* r_t^2 \quad (10-97)$$


In addition, if an indoor RFCS draws ventilation air from the residence, it imposes air conditioning and heating loads. To model these loads, a part-load ventilation airflow factor is defined for units that use indoor air. The part-load ventilation airflow factor, Z_a , is the fraction of the rated ventilation airflow required at the conditions of thermal part-load ratio, r_t , and system ambient temperature T_I :

$$Z_a^* \equiv \frac{\dot{m}_a^*(r_t)}{\dot{m}_a^{R*}} \quad \text{for } T_a = T_I \quad (10-98)$$

The functional form of Z_a is:

$$Z_a^*(r_t) = h_1^* + h_2^* r_t + h_3^* r_t^2 \quad (10-99)$$

where the coefficients are determined by linear regression of the steady state test data. A representative function for the part-load ventilation airflow factor is illustrated in Figure 10.8.

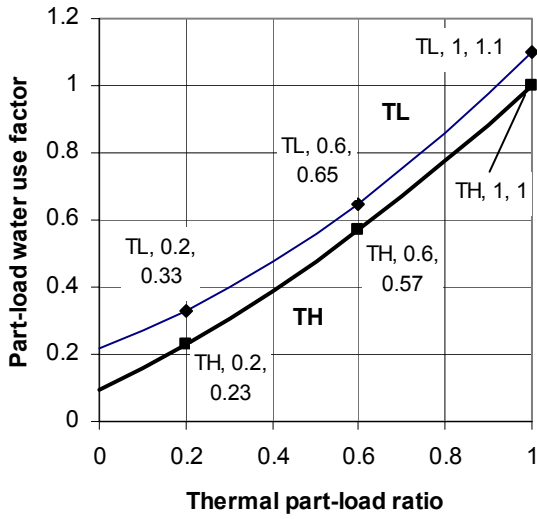


$$Z_r(r_t, T_a) = g_1 + g_2 r_t + g_3 r_t^2 + g_4 r_t T_a + g_5 r_t^2 T_a + g_6 T_a$$

$$g_1 = 0.3125 \quad g_2 = 0.3625 \quad g_3 = 0.5000$$

$$g_4 = 0.00750 \quad g_5 = -0.00625 \quad g_6 = -0.00625$$

Figure 10.7. Representative function for part-load water use factor

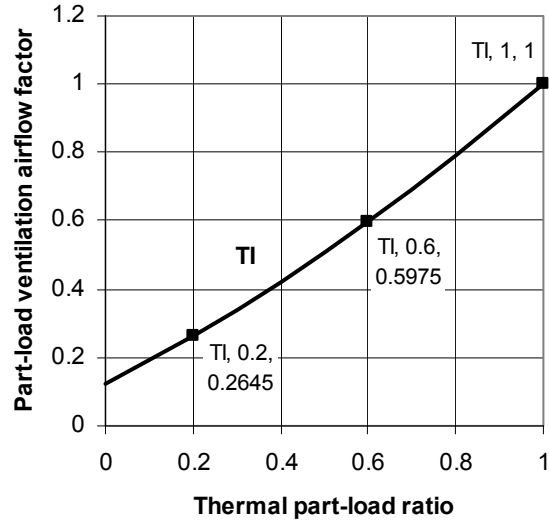

$$Z_a^*(r_e) = h_1^* + h_2^* r_t + h_3^* r_t^2$$

$$h_1^* = 0.1241 \quad h_2^* = 0.6588 \quad h_3^* = 0.2172$$

Figure 10.8. Representative function for part-load ventilation airflow factor

The part-load ventilation airflow factor is used in the annual performance rating procedure to determine the ventilation airflow rate, \dot{m}_a^* , in kg/h (lb_m/h) as a function of the thermal part load ratio:

$$\dot{m}_a^* = Z_a^*(r_t) \dot{m}_a^{R^*} \quad (10-100)$$

10.4.4 Analysis of Simulated Use Data for Type III RFCS

10.4.4.1 Hot water simulated use data for outdoor Type III RFCS

For an outdoor Type II RFCS, the thermal energy provided by the RFCS for water heating is determined for each hour of a hot water simulated use test performed at ambient temperatures of T_H and T_L . In the rating procedure of Section 10.4.5, the values at a particular ambient temperature are estimated based on interpolation between the results at T_H and those at T_L . A similar approach is applied for electrical energy, fuel use, and water use.

Thermal output for water heating. Using data from the hot water simulated use test, hourly values in kW·h (Btu) for thermal energy provided for water heating by the RFCS at T_H and T_L , respectively, are determined from:

$$Q_{whH,i} = \int_{t=t_{i-1}}^{t=t_i} \dot{Q}_{wh}(T_H) dt \quad (10-101a)$$

$$Q_{whL,i} = \int_{t=t_{i-1}}^{t=t_i} \dot{Q}_{wh}(T_L)dt \quad (10-101b)$$

where:

\dot{Q}_{wh} is the thermal output rate evaluated from Eq. 9-4 at the indicated values of power and ambient temperature, kW (Btu/h)

$Q_{whH,i}$ is the thermal energy provided by the RFCS/preheat tank during hour i at ambient temperature T_H , kW·h (Btu)

$Q_{whL,i}$ is the thermal energy provided by the RFCS/preheat tank during hour i at ambient temperature T_L , kW·h (Btu)

The average thermal loss, $Q_{loss,L}$ and $Q_{loss,H}$, are quantities of thermal energy produced by the fuel cell unit during the hot water simulated use tests at ambient temperatures T_L and T_H , respectively, that cannot be supplied as useful heat. They are calculated over the hot water simulated use test as:

$$Q_{loss,L} = \left[\frac{1}{\tau} \int_{t=t_{i-1}}^{t=t_i} \dot{Q}_{loss}(T_L)dt \right] \times 1 \text{ h} \quad (10-102a)$$

$$Q_{loss,H} = \left[\frac{1}{\tau} \int_{t=t_{i-1}}^{t=t_i} \dot{Q}_{loss}(T_H)dt \right] \times 1 \text{ h} \quad (10-102b)$$

where:

\dot{Q}_{loss} is the thermal loss rate evaluated from Eq. 9-5 at the indicated value of ambient temperature.

Electrical energy produced in conjunction with water heating. Using data from the hot water simulated use test, hourly values in kW·h for the electrical energy provided while meeting the loads imposed during the hot water simulated use test at T_H and T_L , respectively, are determined from:

$$E_{whH,i} = \int_{t=t_{i-1}}^{t=t_i} \dot{E}_{fc}(T_H)dt \quad (10-103a)$$

$$E_{whL,i} = \int_{t=t_{i-1}}^{t=t_i} \dot{E}_{fc}(T_L)dt \quad (10-103b)$$

where:

\dot{E}_{fc} is the power output evaluated from Eq. 9-2 at the indicated ambient temperature, kW

$E_{whH,i}$ is the electrical energy provided by the RFCS as a result of meeting the water heating load during hour i at ambient temperature T_H , kW·h

$E_{whL,i}$ is the electrical energy provided by the RFCS as a result of meeting the water heating load during hour i at ambient temperature T_L , kW·h

Fuel use for water heating. Using data from the hot water simulated use test, hourly values in kWh (Btu) for the fuel used to meet the loads imposed during the hot water simulated use test at T_H and T_L , respectively, are determined from:

$$F_{whH,i} = \int_{t=t_{i-1}}^{t=t_i} \dot{F}(T_H) dt \quad (10-104a)$$

$$F_{whL,i} = \int_{t=t_{i-1}}^{t=t_i} \dot{F}(T_L) dt \quad (10-104b)$$

where:

\dot{F} is the fuel use rate evaluated from Eq. 9-1 at the indicated ambient temperature, kW

$F_{whH,i}$ is the fuel used by the RFCS as a result of meeting the water heating load during hour i at ambient temperature T_H , kW·h

$F_{whL,i}$ is the fuel used by the RFCS as a result of meeting the water heating load during hour i at ambient temperature T_L , kW·h

Water use for water heating. Using data from the hot water simulated use test, hourly values in L (gal) for the water used by the RFCS to meet the loads imposed during the hot water simulated use test at T_H and T_L , respectively, are determined from:

$$V_{w,whH,i} = V_{w,i}(T_H) \quad (10-105a)$$

$$V_{w,whL,i} = V_{w,i}(T_L) \quad (10-105b)$$

where:

\dot{V}_w is the water use rate evaluated from Eq. 9-16 at the indicated ambient temperature, L/h (gal/h)

$V_{w,whH,i}$ is the water used by the RFCS as a result of meeting the water heating load during hour i at ambient temperature T_H , L (gal)

$V_{w,whL,i}$ is the water used by the RFCS as a result of meeting the water heating load during hour i at ambient temperature T_L , L (gal)

10.4.4.2 Hot water simulated use data for indoor Type III RFCS

For an indoor Type III RFCS, the thermal energy for water heating, electrical energy, fuel use, and water use during hour i are each evaluated from the following expressions using data from the hot water simulated use test conducted at ambient temperature T_L .

Thermal output for water heating. The thermal energy provided for water heating during hour i expressed in kW·h is given by:

$$Q_{wh,i}^* = \int_{t=t_{i-1}}^{t=t_i} \dot{Q}_{wh}(T_L) dt \quad (10-106)$$

where $\dot{Q}_{wh}(T_L)$ is the rate at which thermal energy is used for water heating evaluated from Eq. 9-4.

The average thermal loss, Q_{loss}^* , in kW·h (Btu) is hourly thermal energy produced by the fuel cell unit that cannot be supplied as useful heat. It is calculated over the hot water simulated use test as:

$$Q_{\text{loss}}^* = \left[\frac{1}{\tau} \int_{t=t_{i-1}}^{t=t_i} \dot{Q}_{\text{loss}}(T_I) dt \right] \times 1 \text{ h} \quad (10-107)$$

Where \dot{Q}_{loss} is the thermal loss rate evaluated from Eq. 9-5 at the indoor ambient temperature, T_I .

Electrical energy produced in conjunction with water heating. The electrical energy produced in conjunction with water heating during hour i expressed in kW·h is given by:

$$E_{\text{wh},i}^* = \int_{t=t_{i-1}}^{t=t_i} \dot{E}_{\text{fc}}(T_I) dt \quad (10-108)$$

where, $\dot{E}_{\text{fc}}(T_I)$ is the power output evaluated from Eq. 9-2.

Fuel use for water heating. The fuel used for water heating during hour i expressed in kW·h is given by:

$$F_{\text{wh},i}^* = \int_{t=t_{i-1}}^{t=t_i} \dot{F}(T_I) dt \quad (10-109)$$

where $\dot{F}(T_I)$ is the fuel use rate evaluated from Eq. 9-1.

Water use for water heating. The water used by the RFCS for water heating during hour i expressed in L (gal) is given by:

$$V_{\text{w},i}^* = V_{\text{w},i} \quad (10-110)$$

where $V_{\text{w},i}$ is the water use rate evaluated from Eq. 9-16.

Ventilation airflow for water heating. For an indoor RFCS that uses indoor air for ventilation, the ventilation airflow required by the unit must be determined because it affects the heating and cooling loads for the residence. The ventilation airflow during hour i expressed in kg/h (lb_m/h) is given by:

$$\dot{m}_{\text{a,wh},i}^* = m_{\text{a},i} \quad (10-111)$$

where $m_{\text{a},i}$ is determined from Eq. 9-11 using results from the hot water simulated use test conducted at T_I .

10.4.5 Annual Performance Rating Procedure for Type III RFCS

10.4.5.1 Overview of rating procedure

Using the procedure described in the Section 10.4.2, steady-state test results can be used to describe the fuel use rate, thermal output rate, ventilation airflow rate, and water use rate of a Type III RFCS as functions of the thermal part load ratio and the ambient temperature.

The approach described in Section 10.4.3 can be used to establish the performance of a RFCS (in combination with a preheat tank) during each hour of a hot water simulated use test. This section describes how the steady-state functions and the hour-by-hour results for the hot water simulated use test can be combined to simulate the annual performance of a Type III RFCS.

10.4.5.2 Rating procedure for outdoor Type III RFCS

For an outdoor Type III RFCS, the thermal energy supplied by the fuel cell system is determined by thermal loads of the residence for water heating and space heating. For each hour, i , the thermal energy for water heating and the corresponding electrical energy output, fuel use, and water use are determined by using the ambient temperature for each hour to interpolate between the results from the hot water simulated use tests conducted at high (T_H) and low (T_L) ambient temperatures:

$$Q_{wh,i} = Q_{whL,i} + (Q_{whH,i} - Q_{whL,i}) \times \frac{T_{a,i} - T_L}{T_H - T_L} \quad (10-112)$$

$$Q_{loss,i} = Q_{loss,L} + (Q_{loss,H} - Q_{loss,L}) \times \frac{T_{a,i} - T_L}{T_H - T_L} \quad (10-113)$$

$$F_{wh,i} = F_{whL,i} + (F_{whH,i} - F_{whL,i}) \times \frac{T_{a,i} - T_L}{T_H - T_L} \quad (10-114)$$

$$E_{wh,i} = E_{whL,i} + (E_{whH,i} - E_{whL,i}) \times \frac{T_{a,i} - T_L}{T_H - T_L} \quad (10-115)$$

$$V_{w,wh,i} = V_{w,whL,i} + (V_{w,whH,i} - V_{w,whL,i}) \times \frac{T_{a,i} - T_L}{T_H - T_L} \quad (10-116)$$

The thermal energy available from the RFCS at full load and the temperature during hour i , $Q_{av,i}$, in kW·h (Btu) is determined by the thermal output part-load factor and the rated output:

$$Q_{av,i} = Z_q(T_{a,i}) \times \dot{Q}^R \times 1 \text{ h} \quad (10-117)$$

The thermal energy that is actually used is the minimum of the available thermal energy and the thermal energy needed for space heating during hour i , $Q_{LS,i}$, and water heating, $Q_{wh,i}$, each expressed in kW·h (Btu):

$$Q_{fc,i} = \min[Q_{av,i}, Q_{LS,i} + Q_{wh,i} + Q_{loss,i}] \quad (10-118)$$

The thermal energy applied to space heating, $Q_{sh,i}$, in kW·h (Btu) is the difference between the total thermal output and the thermal energy required for water heating:

$$Q_{sh,i} = Q_{fc,i} - Q_{wh,i} - Q_{loss,i} \quad (10-119)$$

There is likely some synergy associated with combining the water heating and space heating loads (e.g., less cycling of the system). However, the amounts of electricity produced, fuel used, and water used in the process of meeting the combined water heating

and space heating requirements cannot be less than the amounts associated with water heating alone as reflected in the simulated use tests. Likewise, the amounts of electricity produced, fuel used, and water used in the process of meeting the combined water heating and space heating requirements cannot be less than the amounts associated with meeting the sum of the water heating and space heating loads while operating in steady state mode. Thus, the electrical output, E_i , in kW·h, the fuel use, F_i in kW·h (Btu), and the water use $V_{w,i}$, in L (gal) are each estimated as the maximum of the respective simulated use and steady values:

$$F_i = \max[F_{wh,i}, F_{ss,i}] \quad (10-120)$$

$$E_{fc,i} = \max[E_{wh,i}, E_{fc,ss,i}] \quad (10-121)$$

$$V_{w,i} = \max[V_{w,wh,i}, V_{w,ss,i}] \quad (10-122)$$

where variables associated with water heating are as previously defined and:

$E_{fc,ss,i}$ is the electrical energy produced if the RFCS operated in steady state mode to meet the combined water heating and space heating requirement, kW·h

$F_{ss,i}$ is fuel used if the RFCS operated in steady state mode to meet the combined water heating and space heating requirement, kW·h (Btu)

$V_{w,ss,i}$ is the water used if the RFCS operated in steady state mode to meet the combined water heating and space heating requirement, L (gal)

Values for the electricity produced, fuel used, and water used in conjunction with meeting only the water heating requirement ($F_{wh,i}$, $E_{wh,i}$, and $V_{w,wh,i}$) are determined by Eqs. 10-114, 10-115, and 10-116 respectively. The remaining mass and energy flows used in Eqs. 10-124 to 10-126 (i.e., $E_{fc,ss,i}$, $F_{ss,i}$, and $V_{w,ss,i}$) are determined based on the thermal part-load ratio corresponding to the combined water heating and space heating load:

$$r_{t,i} = \frac{Q_{fc,i}}{\dot{Q}^R \times 1 \text{ h}} \quad (10-123)$$

The thermal part-load ratio is used in conjunction with the functions previously defined for the part-load factors to determine the values for electricity produced, fuel used, and water used in conjunction with meeting both water heating and space heating requirements *if RFCS operation is steady*:

$$E_{fc,ss,i} = Z_e(r_{t,i}, T_{a,i}) \times \dot{E}^R \times 1 \text{ h} \quad (10-124)$$

$$F_{ss,i} = Z_f(r_{t,i}, T_{a,i}) \times \dot{F}^R \times 1 \text{ h} \quad (10-125)$$

$$V_{w,ss,i} = Z_w(r_{t,i}, T_{a,i}) \times \dot{V}_w^R \times 1 \text{ h} \quad (10-126)$$

The electrical energy that is used by the residence is the minimum of the electrical energy available from the fuel cell and the electrical energy requirement of the residence:

$$E_i = \min[E_{fc,i}, E_{L,i}] \quad (10-127)$$

The remaining electrical energy (if any), G_i , in kW·h is supplied to the electrical grid:

$$G_i = E_{fc,i} - E_i \quad (10-128)$$

Annual results are summed over each representative day, weighted by the number of occurrences of each representative day, and reported in the format described in Section 10.1.

10.4.5.3 Rating procedure for indoor Type III RFCS

For an indoor Type III RFCS, there is no dependence of performance on ambient temperature because the ambient temperature is assumed to remain constant at T_i . Thus, the thermal energy output as well as the corresponding electrical energy output, fuel use, and water use are determined strictly by the water heating and space heating requirements of the residence.

The water heating requirement as well as the corresponding electrical energy output, fuel use, water use, and ventilation airflow quantity are determined from the hot water simulated use test as described by Eqs. 10-106, 10-108, 10-109, 10-110, and 10-111.

If the unit uses indoor ventilation air, the thermal energy that is required for heating the ventilation air associated with water heating, $\Delta Q_{a,wh,i}^*$, in kJ (Btu) is given by:

$$\Delta Q_{a,wh,i}^* = \max[\dot{m}_{a,wh,i}^* \times 1 \text{ h} \times c_{pa} (T_{iah} - T_{oa}), 0] \quad (10-129)$$

where:

c_{pa} is the constant pressure specific heat for air at assumed conditions of 5 °C (40 °F) which is 1.004 kJ/kg·°C (0.240 Btu/lb_m·°F)

T_{oa} is the temperature of the outdoor air at hour i , °C (°F)

T_{iah} is the temperature of the indoor air at heating conditions which is 21 °C (70 °F)

The thermal energy used for heating water and the associated ventilation air is subtracted from the rated RFCS thermal output, $Q_{fc,i}^*$, to determine a first approximation for the thermal energy available for space heating from the RFCS:

$$Q_{lav,i}^* = Q_{fc,i}^* - Q_{wh,i}^* - \Delta Q_{a,wh,i}^* - Q_{loss,i}^* \quad (10-130)$$

where the correction, $\Delta Q_{a,wh,i}^*$, is zero if the unit does not use indoor air for ventilation. A first approximation to the thermal output of an indoor Type III RFCS for space heating is the minimum of the available thermal energy and the space heating load:

$$Q_{lsh,i}^* = \min(Q_{lav,i}^*, Q_{Ls,i}) \quad (10-131)$$

This first approximation must be corrected to reflect the increase in thermal energy required by the residence due to heating ventilation air required by the RFCS as it supplies

space heating. The quantity of air is determined by the first approximation to the thermal part-load ratio:

$$r_{lt,i} = \frac{Q_{lsh,i}^* + Q_{wh,i}^* + Q_{loss,i}^*}{\dot{Q}_{fc}^{R*} \times 1 \text{ h}} \quad (10-132)$$

The first approximation to the thermal part-load ratio is used in conjunction with the part-load ventilation air factor to determine the first approximation to the mass of ventilation air associated with space heating, $\dot{m}_{a,sh,i}^*$ in kg (lb_m):

$$\dot{m}_{a,sh,i}^* = Z_a^*(r_{lt,i})\dot{m}_a^{R*} \quad (10-133)$$

The thermal energy that is required for heating the ventilation air associated with space heating is, $\Delta Q_{a,sh,i}$, in kJ (Btu):

$$\Delta Q_{a,sh,i} = \max[\dot{m}_{a,sh,i}^* \times 1 \text{ h} \times c_{pa} (T_{iah} - T_{oa}), 0] \quad (10-134)$$

The net thermal energy for space heating supplied by the RFCS is given by:

$$Q_{sh,i}^* = \min[(\dot{Q}^{R*} \times 1 \text{ h} - Q_{wh,i}^* - \Delta Q_{a,wh,i}^* - \Delta Q_{a,sh,i}^* - Q_{loss,i}^*), Q_{Ls,i}] \quad (10-135)$$

There is likely some synergy associated with combining the water heating and space heating loads (e.g., less cycling of the system). However, the amounts of electricity produced, fuel used, and water used in the process of meeting the combined water heating and space heating requirements cannot be less than the amounts associated with water heating alone as reflected in the simulated use tests. Likewise, the amounts of electricity produced, fuel used, and water used in the process of meeting the combined water heating and space heating requirements cannot be less than the amounts associated with meeting the sum of the water heating and space heating loads while operating in steady state mode. Thus, the electrical output, E_i^* , in kW·h, the fuel use, F_i^* in kWh (Btu), and the water use $V_{w,i}^*$, in L (gal) are each estimated as the maximum of the respective simulated use and steady values:

$$F_i^* = \max[F_{wh,i}^*, F_{ss,i}^*] \quad (10-136)$$

$$E_i^* = \max[E_{wh,i}^*, E_{ss,i}^*] \quad (10-137)$$

$$V_i^* = \max[V_{wh,i}^*, V_{ss,i}^*] \quad (10-138)$$

where variables associated with water heating are as previously defined and:

$E_{fc,ss,i}^*$ is the electrical energy produced if the RFCS operated in steady state mode to meet the combined water heating and space heating requirement, kW·h

$F_{ss,i}^*$ is fuel used if the RFCS operated in steady state mode to meet the combined water heating and space heating requirement, kW·h (Btu)

$V_{w,ss,i}^*$ is the water used if the RFCS operated in steady state mode to meet the combined water heating and space heating requirement, L (gal)

Values for the electricity produced, fuel used, and water used in conjunction with meeting the water heating requirement are determined directly from the simulated use test (Eqs. 10-108, 10-109, and 10-110). The remaining mass and energy flows for steady state operation to meet the combined space heating and water heating requirements ($E_{fc,ss,i}^*$, $F_{ss,i}^*$, $V_{w,ss,i}^*$) are based on the gross thermal energy output of the RFCS:

$$Q_{fc,i}^* = Q_{sh,i}^* + Q_{wh,i}^* + \Delta Q_{a,wh,i}^* + \Delta Q_{a,sh,i}^* + Q_{loss,i}^* \quad (10-139)$$

This gross thermal output is used to determine a thermal part-load ratio:

$$r_{t,i}^* = \frac{Q_{fc,i}^*}{\dot{Q}^{R*} \times 1 \text{ h}} \quad (10-140)$$

For operation in a steady mode to meet both water heating and space heating requirements, the electrical energy output, fuel use, and water use are determined by this thermal part load ratio:

$$E_{fc,ss,i}^* = Z_c^*(r_{t,i}^*) \times \dot{E}^{R*} \times 1 \text{ h} \quad (10-141)$$

$$F_{ss,i}^* = Z_f^*(r_{t,i}^*) \times \dot{F}^{R*} \times 1 \text{ h} \quad (10-142)$$

$$V_{w,ss,i}^* = Z_w^*(r_{t,i}^*) \times \dot{V}_w^{R*} \times 1 \text{ h} \quad (10-143)$$

The electrical energy that is used by the residence is the minimum of the electrical energy available from the fuel cell and the electrical energy requirement of the residence, $E_{L,i}$, in kW·h:

$$E_i^* = \min[E_{fc,i}^*, E_{L,i}] \quad (10-144)$$

The remaining power (if any), G_i^* , in kW·h is supplied to the electrical grid:

$$G_i^* = E_{fc,i}^* - E_i^* \quad (10-145)$$

Annual results are summed over each representative day, weighted by the number of occurrences of each representative day, and reported in the format described in Section 10.1.

10.5 Rated and annual performance for grid interconnected, water heating only Type IV RFCS

10.5.1 Rated performance for outdoor Type IV RFCS

The RFCS is operated to yield *maximum thermal output at an ambient temperature of T_H* . The rated values for the energy and mass flow rates are given by:

$$\text{Coincident power in kW:} \quad \dot{E}^R = \dot{E}_{fc} \quad (10-146a)$$

$$\text{Thermal output rate in kW (Btu/h):} \quad \dot{Q}^R = \dot{Q}_{ss} \quad (10-146b)$$

$$\text{Fuel use rate in kW (Btu/h):} \quad \dot{F}^R = \dot{F} \quad (10-146c)$$

$$\text{Water use rate in L/h (gal/h):} \quad \dot{V}_w^R = \dot{V}_w \quad (10-146d)$$

where the energy and mass flow rates are determined as described in Section 9.2 and are averaged over the duration of the steady-state test.

10.5.2 Rated performance for Type IV RFCS

The RFCS is operated to yield *maximum thermal output at an ambient temperature of T_I for indoor units*. The rated values for the energy and mass flow rates are given by:

$$\text{Coincident power in kW:} \quad \dot{E}^R = \dot{E}_{fc} \quad (10-147a)$$

$$\text{Thermal output rate in kW (Btu/h):} \quad \dot{Q}^R = \dot{Q}_{ss} \quad (10-147b)$$

$$\text{Fuel use rate in kW (Btu/h):} \quad \dot{F}^R = \dot{F} \quad (10-147c)$$

$$\text{Water use rate in L/h (gal/h):} \quad \dot{V}_w^R = \dot{V}_w \quad (10-147d)$$

$$\text{Ventilation airflow rate (if indoor air) in kg/h (lb}_m\text{/h):} \quad \dot{m}_a^R = \dot{m}_a^{\text{on}} \quad (10-147e)$$

where the energy and mass flow rates are determined as described in Section 9.2 and are averaged over the duration of the steady-state test.

10.5.3 Analysis of Simulated Use Data for Type IV RFCS

10.5.3.1 Hot water simulated use data for outdoor Type IV RFCS

For an outdoor Type IV RFCS, the thermal energy provided by the RFCS for water heating is determined for each hour of a hot water simulated use test performed at ambient temperatures of T_H and T_L . In the rating procedure of Section 10.5.4, the values at a particular ambient temperature are estimated based on interpolation between the results at T_H and those at T_L . A similar approach is applied for electrical energy, fuel use, and water use.

Thermal output for water heating. Using data from the hot water simulated use test, hourly values in kW·h (Btu) for thermal energy provided for water heating by the RFCS at T_H and T_L , respectively, are determined from:

$$Q_{\text{whH},i} = \int_{t=t_{i-1}}^{t=t_i} \dot{Q}_{\text{wh}}(T_H) dt \quad (10-148a)$$

$$Q_{whL,i} = \int_{t=t_{i-1}}^{t=t_i} \dot{Q}_{wh}(T_L)dt \quad (10-148b)$$

where:

\dot{Q}_{wh} is the thermal output rate evaluated from Eq. 9-4 at the indicated values of power and ambient temperature, kW (Btu/h)

$Q_{whH,i}$ is the thermal energy provided by the RFCS/preheat tank during hour i at ambient temperature T_H , kWh (Btu)

$Q_{whL,i}$ is the thermal energy provided by the RFCS/preheat tank during hour i at ambient temperature T_L , kW·h (Btu)

Electrical energy produced in conjunction with water heating. Using data from the hot water simulated use test, hourly values in kW·h for the electrical energy provided while meeting the loads imposed during the hot water simulated use test at T_H and T_L , respectively, are determined from:

$$E_{whH,i} = \int_{t=t_{i-1}}^{t=t_i} \dot{E}_{fc}(T_H)dt \quad (10-149a)$$

$$E_{whL,i} = \int_{t=t_{i-1}}^{t=t_i} \dot{E}_{fc}(T_L)dt \quad (10-149b)$$

where:

\dot{E}_{fc} is the power output evaluated from Eq. 9-2 at the indicated ambient temperature, kW

$E_{whH,i}$ is the electrical energy provided by the RFCS as a result of meeting the water heating load during hour i at ambient temperature T_H , kW·h

$E_{whL,i}$ is the electrical energy provided by the RFCS as a result of meeting the water heating load during hour i at ambient temperature T_L , kW·h

Fuel use for water heating. Using data from the hot water simulated use test, hourly values in kW·h (Btu) for the fuel used to meet the loads imposed during the hot water simulated use test at T_H and T_L , respectively, are determined from:

$$F_{whH,i} = \int_{t=t_{i-1}}^{t=t_i} \dot{F}(T_H)dt \quad (10-150a)$$

$$F_{whL,i} = \int_{t=t_{i-1}}^{t=t_i} \dot{F}(T_L)dt \quad (10-150b)$$

where:

\dot{F} is the fuel use rate evaluated from Eq. 9-1 at the indicated ambient temperature, kW

$F_{whH,i}$ is the fuel used by the RFCS as a result of meeting the water heating load during hour i at ambient temperature T_H , kW·h

$F_{whL,i}$ is the fuel used by the RFCS as a result of meeting the water heating load during hour i at ambient temperature T_L , kW·h

Water use for water heating. Using data from the hot water simulated use test, hourly values in L (gal) for the water used by the RFCS to meet the loads imposed during the hot water simulated use test at T_H and T_L , respectively, are determined from:

$$V_{w,whH,i} = V_{w,i}(T_H) \quad (10-151a)$$

$$V_{w,whL,i} = V_{w,i}(T_L) \quad (10-151b)$$

where:

$V_{w,i}$ is the water use rate evaluated from Eq. 9-16 at the indicated ambient temperature, L/h (gal/h)

$V_{w,whH,i}$ is the water used by the RFCS as a result of meeting the water heating load during hour i at ambient temperature T_H , L (gal)

$V_{w,whL,i}$ is the water used by the RFCS as a result of meeting the water heating load during hour i at ambient temperature T_L , L (gal)

10.5.3.2 Hot water simulated use data for indoor Type IV RFCS

For an indoor Type IV RFCS, the thermal energy for water heating, electrical energy, fuel use, and water use during hour i are each evaluated from the following expressions using data from the hot water simulated use test conducted at ambient temperature T_I .

Thermal output for water heating. The thermal energy provided for water heating during hour i expressed in kW·h is given by:

$$Q_{wh,i}^* = \int_{t=t_{i-1}}^{t=t_i} \dot{Q}_{wh}(T_I) dt \quad (10-152)$$

where $\dot{Q}_{wh}(T_I)$ is the rate at which thermal energy is used for water heating evaluated from Eq. 9-4.

Electrical energy produced in conjunction with water heating. The electrical energy produced in conjunction with water heating during hour i expressed in kW·h is given by:

$$E_{wh,i}^* = \int_{t=t_{i-1}}^{t=t_i} \dot{E}_{fc}(T_I) dt \quad (10-153)$$

where, $\dot{E}_{fc}(T_I)$ is the power output evaluated from Eq. 9-2.

Fuel use for water heating. The fuel used for water heating during hour i expressed in kW·h is given by:

$$F_{wh,i}^* = \int_{t=t_{i-1}}^{t=t_i} \dot{F}(T_I) dt \quad (10-154)$$

where $\dot{F}(T_I)$ is the fuel use rate evaluated from Eq. 9-1.

Water use for water heating. The water used by the RFCS for water heating during hour i expressed in L (gal) is given by:

$$V_{w,i}^* = V_{w,i} \quad (10-155)$$

where $V_{w,i}$ is the water use rate evaluated from Eq. 9-16 using results from the how water simulated use test conducted at T_L .

Ventilation airflow for water heating. For an indoor RFCS that draws ventilation air from the indoors, the ventilation airflow required by the unit must be determined because it affects the heating and cooling loads for the residence. The ventilation airflow during hour i expressed in kg/h (lb_m/h) is given by:

$$m_{a,wh,i}^* = m_{a,i} \quad (10-156)$$

where $m_{a,i}$ is determined from Eq. 9-11 using results from the how water simulated use test conducted at T_L .

10.5.4 Annual Performance Rating Procedure for Type IV RFCS

10.5.4.1 Overview of rating procedure

The approach described in Section 10.5.3 can be used to establish the performance of a RFCS (in combination with a preheat tank) during each hour of a hot water simulated use test. This section describes how the hour-by-hour results for the hot water simulated use test can be used to simulate the annual performance of a Type IV RFCS.

10.5.4.2 Rating procedure for outdoor Type IV RFCS

For an outdoor Type IV RFCS, the thermal energy supplied by the fuel cell system is determined by thermal loads of the residence for water heating. For each hour, i , the thermal energy for water heating and the corresponding electrical energy output, fuel use, and water use are determined by using the ambient temperature for each hour to interpolate between the results from the hot water simulated use tests conducted at high (T_H) and low (T_L) ambient temperatures:

$$Q_{wh,i} = Q_{whL,i} + (Q_{whH,i} - Q_{whL,i}) \times \frac{T_{a,i} - T_L}{T_H - T_L} \quad (10-157)$$

$$F_i = F_{whL,i} + (F_{whH,i} - F_{whL,i}) \times \frac{T_{a,i} - T_L}{T_H - T_L} \quad (10-158)$$

$$E_{fc,i} = E_{whL,i} + (E_{whH,i} - E_{whL,i}) \times \frac{T_{a,i} - T_L}{T_H - T_L} \quad (10-159)$$

$$V_{w,i} = V_{w,whL,i} + (V_{w,whH,i} - V_{w,whL,i}) \times \frac{T_{a,i} - T_L}{T_H - T_L} \quad (10-160)$$

The electrical energy that is used by the residence is the minimum of the electrical energy available from the fuel cell and the electrical energy requirement of the residence:

$$E_i = \min[E_{fc,i}, E_{L,i}] \quad (10-161)$$

The remaining electrical energy (if any), G_i , in kW·h is supplied to the electrical grid:

$$G_i = E_{fc,i} - E_i \quad (10-162)$$

Annual results are summed over each representative day, weighted by the number of occurrences of each representative day, and reported in the format described in Section 10.1.

10.5.4.3 Rating procedure for Type IV RFCS

For an indoor Type IV RFCS, there is no dependence of performance on ambient temperature because the ambient temperature is assumed to remain constant at T_1 . Thus, the thermal energy output as well as the corresponding electrical energy output, fuel use, and water use are determined strictly by the water heating requirements of the residence.

The water heating requirement as well as the corresponding electrical energy output, fuel use, water use, and ventilation airflow quantity are determined from the hot water simulated use test as described by Eqs. 10-152 to 10-156.

If the unit draws ventilation air from the indoors, the thermal energy that is required for heating the ventilation air associated with water heating is, $\Delta Q_{a,wh,i}^*$, in kJ (Btu):

$$\Delta Q_{a,wh,i}^* = \max[\dot{m}_{a,wh,i}^* \times 1 \text{ h} \times c_{pa} (T_{iah} - T_{oa}), 0] \quad (10-163)$$

where:

c_{pa} is the constant pressure specific heat for air at assumed conditions of 5 °C (40 °F),

T_{oa} is the temperature of the outdoor air at hour i , °C (°F)

T_{iah} is the temperature of the indoor air at heating conditions which is 21 °C (70 °F)

The contribution of an indoor Type IV RFCS (which uses indoor air for ventilation) to the energy used by the residence for space heating is simply:

$$Q_{sh,i}^* = -\Delta Q_{a,wh,i}^* \quad (10-164)$$

which will be negative, indicating that somewhat more heating is required due to the installation of the indoor Type IV RFCS. The contribution will be zero if the unit does not draw ventilation air from the indoors.

The electrical energy that is used by the residence is the minimum of the electrical energy available from the fuel cell and the electrical energy requirement of the residence, $E_{L,i}$, in kW·h:

$$E_i^* = \min[E_{fc,i}^*, E_{L,i}] \quad (10-165)$$

The remaining power (if any), G_i , in kW·h is supplied to the electrical grid:

$$G_i^* = E_{fc,i}^* - E_i^* \quad (10-166)$$

Annual results are summed over each representative day, weighted by the number of occurrences of each representative day, and reported in the format described in Section 10.1.

11. References

- [1] CSA America, ANSI/CSA America FC 1-2004, *Stationary Fuel Cell Power Systems*, CSA America, 2004
- [2] National Fire Protection Association, NFPA 853, *Installation of Stationary Fuel Cell Power Plants, 2003 Edition*, NFPA, 2003
- [3] American Society of Mechanical Engineers, ASME PTC 50-2002, *Fuel Cell Power Systems Performance*, ASME, New York, 2002.
- [4] M.W. Davis, “Proposed Testing Methodology and Laboratory Facilities for Evaluating Residential Fuel Cell Systems,” NISTIR 6848, Jan. 2002
- [5] American Society of Mechanical Engineers, ASME PTC 19.1-1988, *Test Uncertainty*, ASME, New York, 1988.
- [6] U.S. Department of Energy, Office of Energy Efficiency and Renewable Energy, “Energy Conservation Program for Consumer Products: Test Procedure for Water Heaters”, *Federal Register*, vol.63, No. 90, May 11, 1998.

Appendices

A. Residential Loads and Climate Data for Department of Energy (DOE) Climate Regions

Simulation of the annual energy use of residential fuel cell systems requires knowledge of electrical and thermal loads for residences as well as coincident outdoor conditions. This rating procedure uses building energy simulation results for a prototypical house located in a representative city within each DOE climate zone. The results are aggregated to yield three days representing winter, spring/fall, and summer for each of the climate zones. This data is presented in the following tables:

- Table A.1: Climate Data, Thermal Loads, and Electrical Loads for Region 1 (based on Jacksonville, FL)
- Table A.2: Climate Data, Thermal Loads, and Electrical Loads for Region 2 (based on Charleston, SC)
- Table A.3: Climate Data, Thermal Loads, and Electrical Loads for Region 3 (based on Memphis, TN)
- Table A.4: Climate Data, Thermal Loads, and Electrical Loads for Region 4 (based on Pittsburgh, PA)
- Table A.5: Climate Data, Thermal Loads, and Electrical Loads for Region 5 (based on Minneapolis, MN)
- Table A.6: Climate Data, Thermal Loads, and Electrical Loads for Region 6 (based on Astoria, OR)

Table A.1: Climate Data, Thermal Loads, and Electrical Loads for Region 1 (based on Jacksonville, FL)

Hr	Outdoor Temperature T_{oa} , °C			Outdoor Humidity Ratio ω_{oa} , g/kg			Outdoor Air Enthalpy h_{oa} , kJ/kg			Heating Load Q_{LS} , kW			Electrical Load (no-heat) E_L , kW			Water Heating Load Q_{wh} , kW		
	Wtr	Spr/Fall	Sum	Wtr	Spr/Fall	Sum	Wtr	Spr/Fall	Sum	Wtr	Spr/Fall	Sum	Wtr	Spr/Fall	Sum	Wtr	Spr/Fall	Sum
1	9.41	17.89	23.75	6.62	11.62	16.26	26.17	47.47	65.26	0.939	0.079	0.000	0.200	0.247	0.445	0.033	0.033	0.033
2	9.18	17.53	23.45	6.57	11.53	16.14	25.75	46.87	64.62	1.098	0.101	0.000	0.200	0.225	0.376	0.033	0.033	0.033
3	8.85	17.14	23.14	6.54	11.41	16.01	25.35	46.21	63.92	1.258	0.121	0.000	0.200	0.213	0.322	0.033	0.033	0.033
4	8.63	16.84	22.92	6.50	11.30	15.96	25.02	45.62	63.59	1.432	0.149	0.000	0.200	0.207	0.282	0.033	0.033	0.033
5	8.34	16.57	22.71	6.45	11.16	15.81	24.68	44.94	63.04	1.561	0.176	0.000	0.300	0.304	0.363	0.033	0.033	0.033
6	8.13	16.35	22.58	6.41	11.04	15.66	24.35	44.40	62.51	1.533	0.182	0.000	0.700	0.709	0.804	0.033	0.033	0.033
7	7.90	16.42	23.03	6.36	11.16	16.01	24.00	44.80	63.93	1.341	0.160	0.000	1.400	1.449	1.689	0.033	0.033	0.033
8	8.09	17.64	24.77	6.36	11.59	16.74	24.18	47.14	67.49	1.441	0.158	0.000	0.700	0.747	1.011	0.033	0.033	0.033
9	9.44	19.78	26.65	6.61	12.06	17.22	26.14	50.48	70.74	1.387	0.146	0.000	0.300	0.372	0.667	0.033	0.033	0.033
10	11.52	21.82	28.29	7.02	12.18	17.13	29.25	52.91	72.16	1.088	0.090	0.000	0.200	0.340	0.733	0.033	0.033	0.033
11	13.60	23.46	29.49	7.28	12.12	17.04	32.02	54.41	73.17	0.781	0.051	0.000	0.200	0.435	0.910	0.033	0.033	0.033
12	15.15	24.52	30.41	7.37	12.02	16.96	33.81	55.32	73.96	0.595	0.031	0.000	0.200	0.515	1.042	0.033	0.033	0.033
13	16.01	25.33	31.01	7.33	11.75	16.65	34.68	55.43	73.75	0.453	0.023	0.000	0.202	0.608	1.146	0.033	0.033	0.033
14	16.54	25.70	31.07	7.32	11.64	16.66	35.16	55.49	73.87	0.374	0.017	0.000	0.206	0.700	1.260	0.033	0.033	0.033
15	16.71	25.70	30.73	7.31	11.67	16.75	35.33	55.65	73.70	0.356	0.011	0.000	0.209	0.753	1.331	0.033	0.033	0.033
16	16.63	25.55	30.10	7.27	11.67	16.56	35.09	55.43	72.57	0.322	0.011	0.000	0.309	0.851	1.447	1.920	1.920	1.920
17	16.01	24.85	29.22	7.34	11.84	16.54	34.70	55.15	71.67	0.279	0.007	0.000	0.713	1.255	1.887	1.920	1.920	1.920
18	14.52	23.52	28.33	7.38	11.98	16.62	33.28	54.16	70.92	0.195	0.005	0.000	3.537	4.270	4.984	1.920	1.920	1.920
19	12.82	21.90	27.33	7.22	11.96	16.65	31.13	52.43	69.94	0.223	0.005	0.000	1.612	2.165	2.777	1.920	1.920	1.920
20	11.60	20.55	26.22	7.04	11.88	16.52	29.46	50.84	68.44	0.202	0.008	0.000	2.516	3.029	3.559	1.920	1.920	1.920
21	10.80	19.74	25.35	6.93	11.80	16.48	28.35	49.79	67.52	0.187	0.004	0.000	4.706	5.183	5.682	1.920	1.920	1.920
22	10.30	19.08	24.87	6.87	11.78	16.62	27.68	49.10	67.39	0.283	0.008	0.000	1.704	2.086	2.534	0.033	0.033	0.033
23	9.98	18.62	24.55	6.80	11.76	16.68	27.16	48.58	67.14	0.462	0.026	0.000	0.901	1.114	1.475	0.033	0.033	0.033
24	9.69	18.23	24.15	6.72	11.66	16.49	26.70	47.88	66.21	0.737	0.061	0.000	0.300	0.390	0.644	0.033	0.033	0.033

Table A.2: Climate Data, Thermal Loads, and Electrical Loads for Region 2 (based on Charleston, SC)

Hr	Outdoor Temperature T_{oa} , °C			Outdoor Humidity Ratio ω_{oa} , g/kg			Outdoor Air Enthalpy h_{oa} , kJ/kg			Heating Load Q_{LS} , kW			Electrical Load (no-heat) E_L , kW			Water Heating Load Q_{wh} , kW		
	Wtr	Spr/Fall	Sum	Wtr	Spr/Fall	Sum	Wtr	Spr/Fall	Sum	Wtr	Spr/Fall	Sum	Wtr	Spr/Fall	Sum	Wtr	Spr/Fall	Sum
1	7.14	15.26	22.68	5.42	9.95	15.09	20.83	40.54	61.18	1.934	0.249	0.000	0.201	0.224	0.391	0.033	0.033	0.033
2	6.87	14.93	22.42	5.38	9.82	14.97	20.45	39.89	60.60	2.175	0.308	0.001	0.201	0.213	0.329	0.033	0.033	0.033
3	6.59	14.67	22.18	5.31	9.71	14.84	20.01	39.34	60.03	2.389	0.369	0.000	0.201	0.207	0.285	0.033	0.033	0.033
4	6.32	14.38	21.90	5.25	9.60	14.75	19.58	38.75	59.49	2.612	0.435	0.000	0.201	0.204	0.254	0.033	0.033	0.033
5	6.02	14.09	21.68	5.19	9.48	14.66	19.12	38.16	59.05	2.727	0.492	0.000	0.309	0.311	0.348	0.033	0.033	0.033
6	5.78	13.87	21.64	5.15	9.39	14.62	18.76	37.72	58.89	2.642	0.500	0.000	0.708	0.712	0.784	0.033	0.033	0.033
7	5.53	14.14	22.30	5.11	9.49	14.97	18.41	38.24	60.47	2.398	0.425	0.000	1.380	1.409	1.640	0.033	0.033	0.033
8	5.77	15.59	23.84	5.16	9.87	15.46	18.80	40.67	63.33	2.508	0.395	0.000	0.708	0.734	0.984	0.033	0.033	0.033
9	7.09	17.75	25.57	5.39	10.18	15.56	20.69	43.67	65.35	2.416	0.332	0.000	0.309	0.354	0.641	0.033	0.033	0.033
10	8.90	19.78	27.04	5.56	10.21	15.38	22.98	45.81	66.41	1.977	0.203	0.000	0.237	0.326	0.732	0.033	0.033	0.033
11	10.65	21.31	28.21	5.64	10.10	15.30	24.95	47.12	67.42	1.483	0.110	0.000	0.237	0.373	0.884	0.033	0.033	0.033
12	12.06	22.41	29.00	5.65	10.05	15.23	26.40	48.11	68.05	1.076	0.063	0.000	0.237	0.424	0.990	0.033	0.033	0.033
13	13.22	23.06	29.49	5.63	9.98	15.13	27.52	48.59	68.32	0.863	0.046	0.000	0.237	0.475	1.091	0.033	0.033	0.033
14	13.87	23.40	29.64	5.58	9.96	15.07	28.06	48.89	68.32	0.714	0.037	0.000	0.237	0.519	1.165	0.033	0.033	0.033
15	14.01	23.39	29.43	5.55	10.00	14.96	28.13	48.99	67.82	0.657	0.036	0.000	0.237	0.544	1.221	0.033	0.033	0.033
16	13.87	23.01	29.00	5.56	10.09	14.97	28.01	48.80	67.39	0.659	0.049	0.000	0.309	0.620	1.308	1.920	1.920	1.920
17	13.12	22.17	28.35	5.59	10.13	15.04	27.31	48.07	66.91	0.655	0.061	0.000	0.713	1.026	1.725	1.920	1.920	1.920
18	11.84	20.77	27.55	5.65	10.18	15.21	26.17	46.75	66.52	0.495	0.035	0.000	3.512	3.979	4.835	1.920	1.920	1.920
19	10.57	19.23	26.50	5.67	10.22	15.41	24.93	45.29	65.93	0.577	0.040	0.000	1.566	1.897	2.635	1.920	1.920	1.920
20	9.63	18.03	25.29	5.63	10.25	15.56	23.88	44.12	65.05	0.570	0.048	0.000	2.480	2.793	3.449	1.920	1.920	1.920
21	8.90	17.20	24.41	5.60	10.27	15.58	23.08	43.32	64.20	0.605	0.049	0.000	4.721	5.007	5.633	1.920	1.920	1.920
22	8.33	16.60	23.87	5.58	10.23	15.54	22.44	42.62	63.55	0.807	0.063	0.000	1.725	1.951	2.500	0.033	0.033	0.033
23	7.93	16.12	23.39	5.56	10.16	15.36	21.98	41.95	62.59	1.178	0.112	0.000	0.946	1.059	1.458	0.033	0.033	0.033
24	7.61	15.67	23.03	5.54	10.06	15.19	21.62	41.25	61.77	1.638	0.188	0.000	0.273	0.315	0.559	0.033	0.033	0.033

Table A.3: Climate Data, Thermal Loads, and Electrical Loads for Region 3 (based on Memphis, TN)

Hr	Outdoor Temperature T_{oa} , °C			Outdoor Humidity Ratio ω_{oa} , g/kg			Outdoor Air Enthalpy h_{oa} , kJ/kg			Heating Load Q_{Ls} , kW			Electrical Load (no-heat) E_L , kW			Water Heating Load Q_{wh} , kW		
	Wtr	Spr/Fall	Sum	Wtr	Spr/Fall	Sum	Wtr	Spr/Fall	Sum	Wtr	Spr/Fall	Sum	Wtr	Spr/Fall	Sum	Wtr	Spr/Fall	Sum
1	4.57	14.43	23.68	3.88	8.63	14.69	14.31	36.35	61.13	3.006	0.436	0.000	0.200	0.229	0.446	0.033	0.033	0.033
2	4.31	14.06	23.27	3.83	8.57	14.60	13.87	35.83	60.52	3.210	0.530	0.000	0.200	0.218	0.377	0.033	0.033	0.033
3	3.95	13.69	22.91	3.80	8.52	14.54	13.54	35.31	60.03	3.416	0.621	0.000	0.200	0.210	0.327	0.033	0.033	0.033
4	3.75	13.32	22.60	3.80	8.49	14.48	13.28	34.89	59.53	3.560	0.698	0.000	0.200	0.206	0.290	0.033	0.033	0.033
5	3.43	13.04	22.33	3.80	8.47	14.40	13.03	34.54	59.10	3.620	0.761	0.000	0.300	0.304	0.370	0.033	0.033	0.033
6	3.29	12.87	22.37	3.79	8.48	14.43	12.80	34.39	59.21	3.509	0.762	0.000	0.700	0.711	0.842	0.033	0.033	0.033
7	3.30	13.38	23.43	3.83	8.66	14.77	13.03	35.37	61.19	3.163	0.623	0.000	1.400	1.444	1.768	0.033	0.033	0.033
8	3.85	14.83	25.18	3.91	8.96	15.28	13.70	37.58	64.24	3.185	0.587	0.000	0.700	0.748	1.106	0.033	0.033	0.033
9	4.58	16.58	26.75	4.01	9.20	15.58	14.65	40.00	66.66	3.085	0.542	0.000	0.300	0.362	0.774	0.033	0.033	0.033
10	5.64	18.15	28.12	4.14	9.31	15.64	16.01	41.87	68.15	2.639	0.372	0.000	0.200	0.292	0.821	0.033	0.033	0.033
11	6.76	19.39	29.12	4.27	9.33	15.64	17.53	43.18	69.19	2.193	0.236	0.000	0.200	0.330	0.954	0.033	0.033	0.033
12	7.93	20.50	29.89	4.37	9.31	15.53	18.92	44.23	69.74	1.843	0.160	0.000	0.200	0.366	1.083	0.033	0.033	0.033
13	8.60	21.26	30.32	4.42	9.24	15.50	19.79	44.87	70.13	1.527	0.113	0.000	0.200	0.405	1.193	0.033	0.033	0.033
14	8.98	21.71	30.58	4.44	9.15	15.27	20.23	45.13	69.84	1.346	0.083	0.000	0.200	0.437	1.272	0.033	0.033	0.033
15	9.31	21.96	30.78	4.46	9.07	14.94	20.61	45.16	69.15	1.340	0.079	0.000	0.200	0.456	1.318	0.033	0.033	0.033
16	9.16	21.80	30.60	4.49	8.99	14.78	20.51	44.77	68.55	1.395	0.093	0.000	0.300	0.554	1.405	1.920	1.920	1.920
17	8.53	21.03	30.12	4.49	8.98	14.67	19.87	44.01	67.79	1.437	0.094	0.000	0.700	0.954	1.812	1.920	1.920	1.920
18	7.85	20.02	29.47	4.48	8.96	14.65	19.17	42.92	67.06	1.073	0.052	0.000	3.500	3.888	4.916	1.920	1.920	1.920
19	7.27	18.83	28.51	4.45	8.96	14.73	18.51	41.69	66.23	1.312	0.069	0.000	1.600	1.887	2.737	1.920	1.920	1.920
20	6.71	17.66	27.19	4.39	8.98	14.89	17.80	40.56	65.30	1.315	0.081	0.000	2.500	2.779	3.545	1.920	1.920	1.920
21	6.15	16.71	26.13	4.30	8.94	14.96	17.02	39.50	64.35	1.356	0.090	0.000	4.700	4.959	5.694	1.920	1.920	1.920
22	5.78	15.98	25.27	4.21	8.85	14.91	16.39	38.53	63.41	1.622	0.147	0.000	1.700	1.905	2.550	0.033	0.033	0.033
23	5.38	15.45	24.59	4.14	8.77	14.85	15.88	37.71	62.52	2.144	0.240	0.000	0.900	1.013	1.475	0.033	0.033	0.033
24	4.99	14.90	23.96	4.06	8.68	14.75	15.29	36.95	61.68	2.714	0.368	0.000	0.300	0.351	0.643	0.033	0.033	0.033

Table A.4: Climate Data, Thermal Loads, and Electrical Loads for Region 4 (based on Pittsburgh, PA)

Hr	Outdoor Temperature T_{oa} , °C			Outdoor Humidity Ratio ω_{oa} , g/kg			Outdoor Air Enthalpy h_{oa} , kJ/kg			Heating Load Q_{LS} , kW			Electrical Load (no-heat) E_L , kW			Water Heating Load Q_{wh} , kW		
	Wtr	Spr/Fall	Sum	Wtr	Spr/Fall	Sum	Wtr	Spr/Fall	Sum	Wtr	Spr/Fall	Sum	Wtr	Spr/Fall	Sum	Wtr	Spr/Fall	Sum
1	-2.50	8.71	18.17	2.52	5.88	10.96	3.79	23.57	46.04	5.031	1.492	0.004	0.201	0.202	0.236	0.033	0.033	0.033
2	-2.69	8.31	17.69	2.49	5.85	10.92	3.52	23.11	45.46	5.247	1.647	0.006	0.201	0.201	0.214	0.033	0.033	0.033
3	-2.90	7.94	17.16	2.47	5.84	10.84	3.27	22.69	44.72	5.453	1.797	0.009	0.201	0.201	0.206	0.033	0.033	0.033
4	-3.09	7.53	16.67	2.45	5.79	10.75	3.04	22.16	43.97	5.569	1.927	0.012	0.201	0.201	0.203	0.033	0.033	0.033
5	-3.26	7.20	16.36	2.44	5.74	10.70	2.83	21.69	43.54	5.524	2.028	0.017	0.309	0.309	0.309	0.033	0.033	0.033
6	-3.43	6.99	16.39	2.43	5.71	10.74	2.63	21.42	43.66	5.279	1.986	0.015	0.708	0.708	0.711	0.033	0.033	0.033
7	-3.54	7.12	17.28	2.44	5.77	11.06	2.54	21.70	45.40	4.940	1.751	0.008	1.380	1.382	1.425	0.033	0.033	0.033
8	-3.60	8.06	19.00	2.46	5.93	11.46	2.52	23.05	48.18	5.144	1.776	0.008	0.708	0.710	0.749	0.033	0.033	0.033
9	-3.22	9.48	20.79	2.52	6.09	11.68	3.07	24.90	50.57	5.222	1.735	0.009	0.309	0.312	0.382	0.033	0.033	0.033
10	-2.42	10.88	22.41	2.61	6.20	11.71	4.10	26.61	52.31	4.976	1.480	0.005	0.237	0.244	0.387	0.033	0.033	0.033
11	-1.48	12.16	23.79	2.70	6.25	11.61	5.27	28.03	53.48	4.588	1.229	0.003	0.237	0.253	0.493	0.033	0.033	0.033
12	-0.63	13.26	24.87	2.77	6.25	11.55	6.30	29.15	54.42	4.258	1.035	0.001	0.237	0.263	0.609	0.033	0.033	0.033
13	0.07	14.19	25.69	2.82	6.24	11.43	7.15	30.08	54.95	3.980	0.926	0.000	0.237	0.278	0.709	0.033	0.033	0.033
14	0.57	14.78	26.13	2.85	6.25	11.32	7.71	30.68	55.12	3.873	0.861	0.000	0.237	0.292	0.772	0.033	0.033	0.033
15	0.96	15.02	26.34	2.88	6.20	11.23	8.18	30.82	55.10	3.844	0.846	0.000	0.237	0.299	0.821	0.033	0.033	0.033
16	1.11	15.07	26.33	2.89	6.11	11.17	8.37	30.62	54.94	3.794	0.867	0.000	0.309	0.372	0.892	1.920	1.920	1.920
17	0.79	14.74	25.89	2.85	6.05	11.18	7.95	30.13	54.51	3.766	0.848	0.000	0.713	0.777	1.316	1.920	1.920	1.920
18	0.23	14.03	25.20	2.81	6.04	11.17	7.27	29.39	53.77	3.030	0.622	0.000	3.509	3.629	4.384	1.920	1.920	1.920
19	-0.31	13.06	24.24	2.77	6.00	11.21	6.62	28.30	52.92	3.408	0.761	0.000	1.566	1.649	2.263	1.920	1.920	1.920
20	-0.75	12.06	22.89	2.74	5.93	11.25	6.10	27.11	51.63	3.295	0.707	0.000	2.480	2.558	3.112	1.920	1.920	1.920
21	-1.17	11.16	21.59	2.73	5.91	11.21	5.66	26.15	50.19	3.281	0.674	0.000	4.721	4.789	5.314	1.920	1.920	1.920
22	-1.53	10.32	20.50	2.70	5.94	11.15	5.22	25.36	48.93	3.637	0.793	0.000	1.725	1.773	2.197	0.033	0.033	0.033
23	-1.88	9.65	19.53	2.64	5.93	11.08	4.73	24.66	47.75	4.195	1.034	0.000	0.946	0.963	1.200	0.033	0.033	0.033
24	-2.21	9.14	18.74	2.59	5.89	11.03	4.27	24.05	46.82	4.808	1.328	0.002	0.273	0.277	0.360	0.033	0.033	0.033

Table A.5: Climate Data, Thermal Loads, and Electrical Loads for Region 5 (based on Minneapolis, MN)

Hr	Outdoor Temperature T_{oa} , °C			Outdoor Humidity Ratio ω_{oa} , g/kg			Outdoor Air Enthalpy h_{oa} , kJ/kg			Heating Load Q_{Ls} , kW			Electrical Load (no-heat) E_L , kW			Water Heating Load Q_{wh} , kW		
	Wtr	Spr/Fall	Sum	Wtr	Spr/Fall	Sum	Wtr	Spr/Fall	Sum	Wtr	Spr/Fall	Sum	Wtr	Spr/Fall	Sum	Wtr	Spr/Fall	Sum
1	-10.15	6.31	18.44	1.55	5.04	11.17	-6.33	19.05	46.88	6.575	2.109	0.000	0.201	0.202	0.236	0.033	0.033	0.033
2	-10.44	5.96	17.97	1.53	5.02	11.02	-6.67	18.63	45.99	6.664	2.279	0.000	0.201	0.201	0.218	0.033	0.033	0.033
3	-10.69	5.67	17.48	1.52	5.00	10.85	-6.96	18.28	45.08	6.761	2.445	0.000	0.201	0.201	0.208	0.033	0.033	0.033
4	-10.90	5.41	17.23	1.50	4.99	10.79	-7.21	18.00	44.67	6.822	2.572	0.001	0.201	0.201	0.205	0.033	0.033	0.033
5	-11.06	5.13	17.19	1.49	4.97	10.79	-7.40	17.66	44.62	6.899	2.666	0.002	0.309	0.309	0.311	0.033	0.033	0.033
6	-11.24	4.92	17.26	1.47	4.96	10.88	-7.63	17.44	44.91	6.840	2.600	0.001	0.708	0.708	0.718	0.033	0.033	0.033
7	-11.40	5.44	18.13	1.45	5.06	11.08	-7.84	18.21	46.33	6.578	2.282	0.000	1.380	1.383	1.445	0.033	0.033	0.033
8	-11.48	6.54	19.59	1.44	5.19	11.30	-7.95	19.67	48.38	6.794	2.260	0.000	0.708	0.710	0.768	0.033	0.033	0.033
9	-11.21	7.75	21.05	1.45	5.32	11.46	-7.66	21.20	50.27	6.713	2.245	0.000	0.309	0.312	0.391	0.033	0.033	0.033
10	-10.45	8.95	22.30	1.48	5.43	11.59	-6.82	22.69	51.89	6.337	1.967	0.000	0.237	0.242	0.366	0.033	0.033	0.033
11	-9.38	10.08	23.36	1.54	5.50	11.69	-5.58	24.03	53.24	5.865	1.714	0.000	0.237	0.246	0.426	0.033	0.033	0.033
12	-8.33	11.15	24.28	1.61	5.54	11.75	-4.35	25.23	54.33	5.575	1.538	0.000	0.237	0.254	0.489	0.033	0.033	0.033
13	-7.46	11.87	24.91	1.68	5.54	11.77	-3.32	25.96	55.01	5.343	1.401	0.000	0.237	0.261	0.564	0.033	0.033	0.033
14	-6.84	12.32	25.27	1.72	5.52	11.77	-2.57	26.35	55.39	5.245	1.321	0.000	0.237	0.271	0.616	0.033	0.033	0.033
15	-6.58	12.71	25.53	1.75	5.50	11.76	-2.25	26.70	55.64	5.251	1.326	0.000	0.237	0.277	0.643	0.033	0.033	0.033
16	-6.67	12.58	25.50	1.75	5.48	11.75	-2.34	26.52	55.58	5.375	1.369	0.000	0.309	0.348	0.734	1.920	1.920	1.920
17	-7.13	12.00	25.24	1.73	5.45	11.73	-2.85	25.86	55.26	5.495	1.363	0.000	0.713	0.750	1.173	1.920	1.920	1.920
18	-7.76	11.30	24.87	1.70	5.41	11.71	-3.56	25.03	54.82	4.713	1.022	0.000	3.509	3.581	4.271	1.920	1.920	1.920
19	-8.31	10.38	23.92	1.68	5.37	11.71	-4.17	24.01	53.85	5.121	1.153	0.000	1.566	1.614	2.175	1.920	1.920	1.920
20	-8.70	9.39	22.62	1.66	5.34	11.67	-4.60	22.91	52.43	4.997	1.094	0.000	2.480	2.524	3.047	1.920	1.920	1.920
21	-9.01	8.49	21.40	1.64	5.28	11.54	-4.97	21.85	50.83	4.995	1.076	0.000	4.721	4.758	5.258	1.920	1.920	1.920
22	-9.29	7.79	20.45	1.62	5.22	11.41	-5.31	20.99	49.53	5.329	1.239	0.000	1.725	1.751	2.153	0.033	0.033	0.033
23	-9.61	7.25	19.69	1.59	5.17	11.31	-5.68	20.31	48.51	5.915	1.543	0.000	0.946	0.955	1.171	0.033	0.033	0.033
24	-9.92	6.76	18.97	1.57	5.12	11.22	-6.05	19.69	47.54	6.472	1.908	0.000	0.273	0.275	0.349	0.033	0.033	0.033

Table A.6: Climate Data, Thermal Loads, and Electrical Loads for Region 6 (based on Astoria, OR)

Hr	Outdoor Temperature			Outdoor Humidity Ratio			Outdoor Air Enthalpy			Heating Load			Electrical Load (no-heat)			Water Heating Load		
	T _{oa} , °C			ω _{oa} , g/kg			h _{oa} , kJ/kg			Q _{LS} , kW			E _L , kW			Q _{wh} , kW		
	Wtr	Spr/Fall	Sum	Wtr	Spr/Fall	Sum	Wtr	Spr/Fall	Sum	Wtr	Spr/Fall	Sum	Wtr	Spr/Fall	Sum	Wtr	Spr/Fall	Sum
1	4.81	8.12	13.15	4.90	5.96	7.85	17.23	23.21	33.04	2.997	1.624	0.100	0.200	0.200	0.200	0.033	0.033	0.033
2	4.90	7.95	12.99	4.89	5.91	7.81	17.18	22.88	32.81	3.091	1.763	0.141	0.200	0.200	0.200	0.033	0.033	0.033
3	4.88	7.81	12.81	4.88	5.89	7.76	17.16	22.69	32.53	3.218	1.907	0.200	0.200	0.200	0.200	0.033	0.033	0.033
4	4.91	7.74	12.68	4.86	5.87	7.72	17.13	22.55	32.26	3.379	2.047	0.276	0.200	0.200	0.200	0.033	0.033	0.033
5	4.87	7.68	12.85	4.84	5.87	7.77	17.04	22.53	32.57	3.358	2.090	0.303	0.300	0.300	0.300	0.033	0.033	0.033
6	4.79	7.80	13.24	4.83	5.88	7.90	16.93	22.61	33.27	3.172	1.933	0.216	0.700	0.700	0.700	0.033	0.033	0.033
7	4.70	8.02	13.77	4.81	5.92	8.05	16.82	22.93	34.14	2.844	1.563	0.100	1.400	1.400	1.400	0.033	0.033	0.033
8	4.99	8.83	14.45	4.86	6.12	8.28	17.17	24.26	35.46	2.998	1.575	0.090	0.700	0.700	0.700	0.033	0.033	0.033
9	5.43	10.01	15.36	4.94	6.36	8.50	17.85	26.08	36.97	3.085	1.620	0.145	0.300	0.300	0.300	0.033	0.033	0.033
10	5.93	11.16	16.32	5.03	6.53	8.69	18.53	27.63	38.41	2.938	1.469	0.102	0.200	0.200	0.200	0.033	0.033	0.033
11	6.45	11.95	17.11	5.13	6.60	8.83	19.35	28.64	39.52	2.555	1.212	0.048	0.200	0.200	0.200	0.033	0.033	0.033
12	7.08	12.54	17.62	5.23	6.62	8.95	20.24	29.33	40.42	2.329	1.086	0.021	0.200	0.200	0.200	0.033	0.033	0.033
13	7.68	13.11	18.25	5.32	6.68	9.06	21.12	30.05	41.26	2.278	1.073	0.022	0.200	0.202	0.202	0.033	0.033	0.033
14	7.92	13.25	18.44	5.35	6.68	9.06	21.39	30.23	41.53	2.080	0.957	0.016	0.200	0.205	0.211	0.033	0.033	0.033
15	7.82	13.05	18.29	5.33	6.66	8.99	21.25	29.98	41.20	2.015	0.946	0.013	0.200	0.207	0.215	0.033	0.033	0.033
16	7.73	12.85	17.99	5.30	6.65	8.88	21.10	29.70	40.63	2.151	1.007	0.015	0.300	0.307	0.313	1.920	1.920	1.920
17	7.22	12.28	17.43	5.24	6.61	8.73	20.49	29.05	39.67	2.092	0.935	0.006	0.700	0.707	0.713	1.920	1.920	1.920
18	6.62	11.58	16.67	5.14	6.52	8.56	19.56	28.09	38.44	1.432	0.571	0.002	3.500	3.515	3.539	1.920	1.920	1.920
19	5.93	10.75	15.80	5.04	6.42	8.40	18.61	26.98	37.18	1.722	0.716	0.006	1.600	1.607	1.616	1.920	1.920	1.920
20	5.55	10.08	15.16	4.98	6.33	8.29	18.10	26.08	36.15	1.564	0.645	0.005	2.500	2.508	2.518	1.920	1.920	1.920
21	5.40	9.53	14.48	4.98	6.26	8.19	17.93	25.37	35.28	1.517	0.600	0.006	4.700	4.704	4.715	1.920	1.920	1.920
22	5.20	9.07	13.92	4.97	6.19	8.09	17.76	24.72	34.47	1.883	0.747	0.007	1.700	1.701	1.707	0.033	0.033	0.033
23	5.10	8.67	13.59	4.95	6.10	8.01	17.56	24.13	33.89	2.323	1.035	0.016	0.900	0.900	0.900	0.033	0.033	0.033
24	4.95	8.40	13.40	4.92	6.02	7.93	17.37	23.60	33.49	2.777	1.419	0.051	0.300	0.300	0.300	0.033	0.033	0.033

B. Example calculation

B.1 General Description

For the purpose of an example, the rating methodology was applied to a thermal load following fuel cell system (Type III), which was installed in the Residential Fuel Cell Test Facility at the National Institute of Standards and Technology (NIST) in Gaithersburg. The system was designed for indoor use. Table B.1 shows the measured results for the three steady state tests at the maximum, midpoint, and the minimum thermal energy delivery.

Table B.1. Average measured values over duration of each steady-state test

Variable	Description	Thermal Energy Delivery			Expanded Uncertainty (k=2)
		Max	Mid	Min	
\dot{E}_{in}	electrical power supplied to fuel cell system, kW	0.0	0.0	0.0	0.7 %
\dot{E}_{out}	electrical power supplied by the fuel cell system, kW	4.61	2.75	1.06	0.7 %
\dot{E}_{aux}	electrical power supplied to auxiliary devices (pumps, etc.) not powered by the RFCS, kW	0.6	0.6	0.6	0.7 %
p_a	absolute pressure of air surrounding the RFCS, kPa	100.0	99.0	99.9	0.3
p_f	absolute pressure of fuel gas at flow measurement point, kPa	102.1	101.1	102.0	0.8 %
RH_a	relative humidity of air surrounding the RFCS, %	49.7	49.6	49.7	1.4
T_a	temperature of air surrounding the RFCS, °C	22.2	22.1	22.1	0.3
T_f	temperature of fuel gas, °C	27.6	26.8	27.8	0.3
T_{he}	temperature of circulating fluid at the exit from the RFCS, °C	54.4	52.6	51.3	0.05
T_{hi}	temperature of circulating fluid at the inlet to the RFCS, °C	50.0	50.0	50.0	0.05
T_v	temperature of the exhaust gas, °C	44.1	44.1	44.2	0.3
\dot{V}_f	volumetric flow rate of fuel at standard conditions (T^0, P^0), L/s	0.467	0.307	0.181	0.2%
\dot{V}_h	volumetric flow rate of circulating fluid through the RFCS, L/s	0.448	0.448	0.448	1.2 %
H_f^0	specific energy content of fuel gas at standard conditions (T^0, P^0), kJ/L	38.9	38.8	38.9	0.55 %
X_{CO_2}	volume fraction of CO ₂ in dry exhaust gas	0.0046	0.0036	0.0025	1 %

From these measured values, the calculations in Table B.2 were performed according to Section 9.2. The calculated water use rate could not be measured as indicated. NIST does not have the capability to fill the water reservoir as indicated in Section 9.2.6. Therefore, the water use was measured during each steady state test. Because the test did not necessarily start at the beginning of a water fill cycle and the reservoir was not filled upon completion of the test, these measurements are not necessarily the actual water use rates. It is assumed that manufacturers would provide the independent test facility performing the actual rating with the ability to fill the reservoir, if one exists.

Table B.2. Calculated values over each steady state test

Variable	Description	Eqn	Thermal Energy Delivery			Expanded Uncertainty (k=2)
			Max	Mid	Min	
\dot{F}	Fuel use rate, kW	9-1	18.14	12.00	7.01	0.6 %
\dot{E}_{fc}	Net electrical power provided by the fuel cell system, kW	9-2	4.01	2.15	0.46	0.7 %
\dot{Q}_{fc}	Steady-state thermal output rate, kW	9-3	7.19	4.11	2.04	3.5 %
\dot{m}_a^{on}	Airflow rate into the RFCS while running, kg/s	9-10	0.106	0.090	0.077	5.0 %
\dot{V}_w	Water use rate L/h	9-15	0.0	0.0	2.48	1.0 %

B.2 Nominal performance of a thermal load following RFCS (Type III)

According to Section 9.3.3, the nominal performance of the tested system is shown below. As stated above, the water use rate could not be measured as prescribed, which resulted in zero water use measured at the maximum thermal energy delivery. For the purpose of this example, the nominal water use rate will be the average of the water use rate during the midpoint and minimum steady state tests.

$$\dot{E}^R = 4.61 \text{ kW}$$

$$\dot{F}^R = 18.14 \text{ kW}$$



$$\dot{Q}^R = 7.01 \text{ kW}$$



$$\dot{m}_a^R = 0.106 \text{ kg/s}$$

$$\dot{V}_w^R = 0.0 \text{ L/s}$$

B.3 Part-Load Functions

Part load functions were regressed using the procedure outlined in Section 9.4.3 using the steady state test data presented above. As explained above, the airflow rate function could not be determined, but it will be added later. The following figures show the part load measured data and functions. Since the unit tested was specified as an indoor system, the quadratic regressions were performed for part load ratio, but not ambient temperature. The water use function was normalized to the water use at minimum thermal energy delivery instead of the maximum as specified. As mentioned earlier, the measured water use at maximum thermal energy delivery was zero.

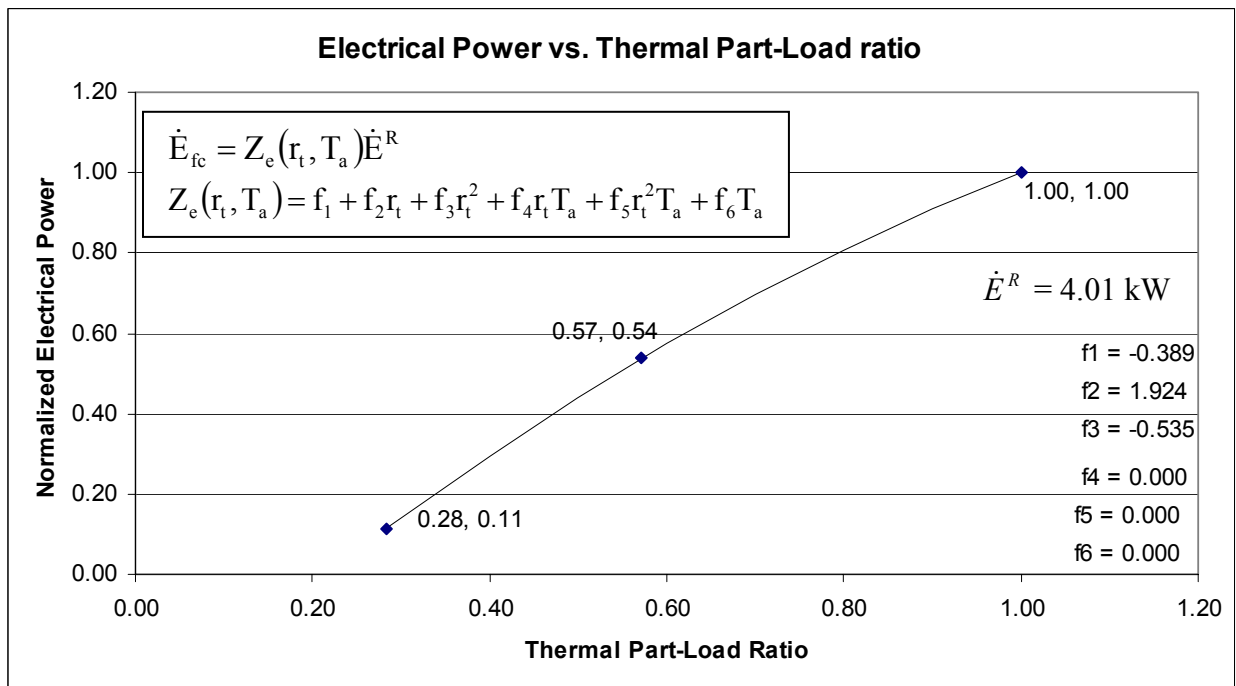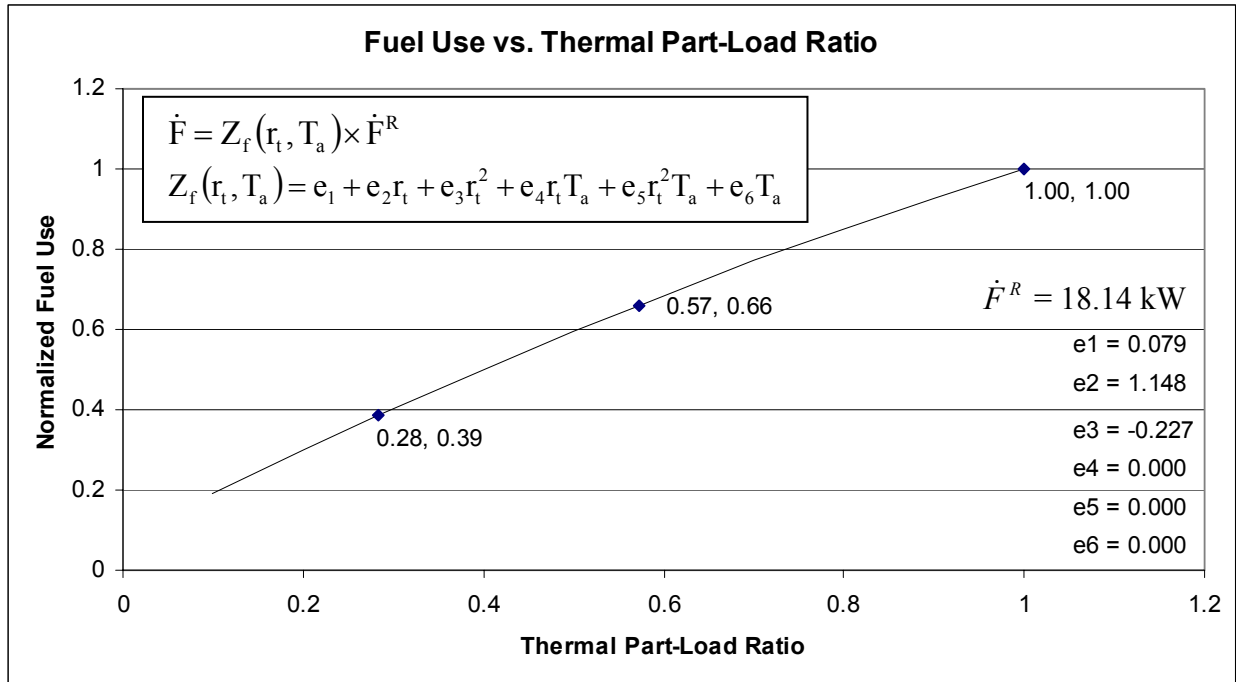

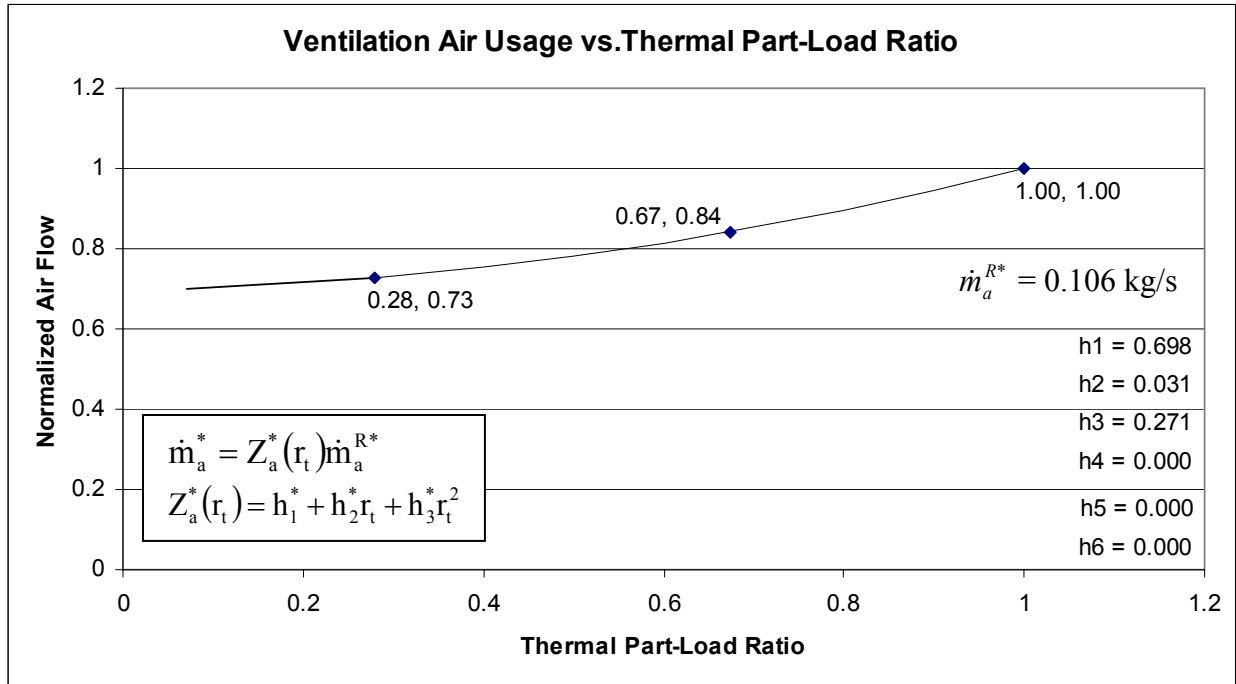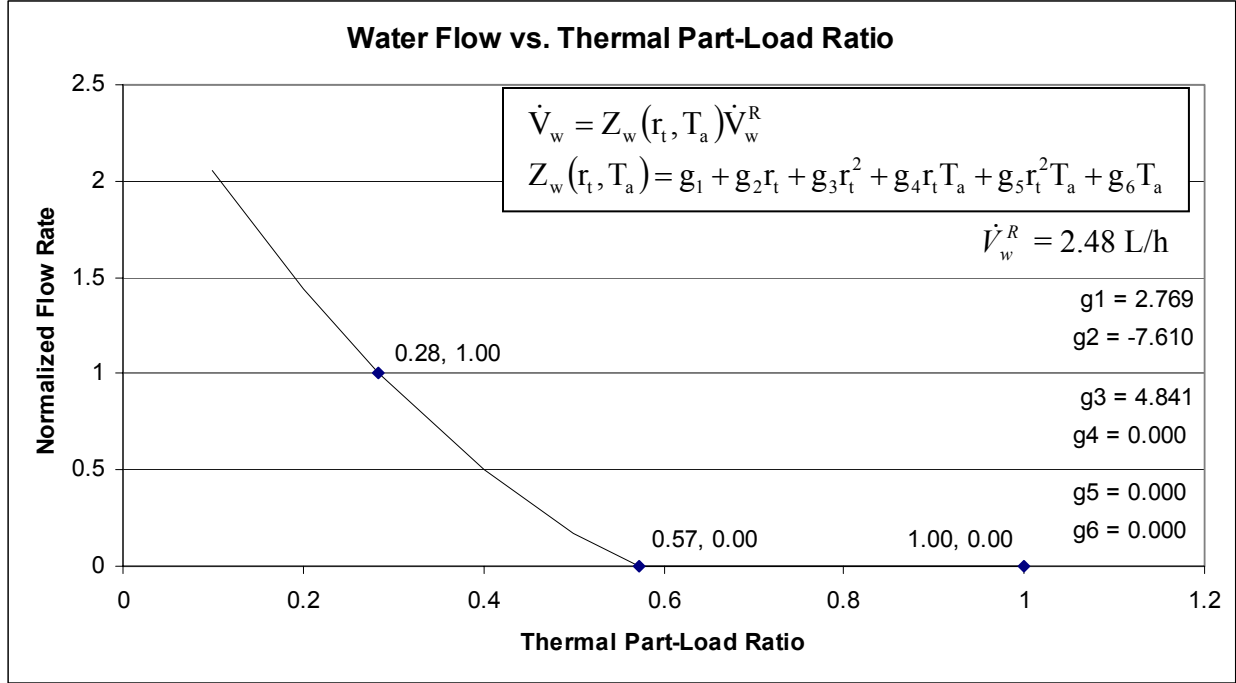

B.4 Simulated Use Data

The hourly thermal energy delivery, electrical energy production, fuel use, and water use were calculated (Table B.4), according to Section 9.5.3, from the simulated use data, which was gathered according to Section 8.1. As an indoor system, the functional relationships 9-49 through 9-53 were not applicable, and the hourly values for each variable will not be scaled according to ambient temperature.

Table B.4. Hourly calculated values for simulated use test

Hour	Domestic Hot Water Withdrawn from Tank (m ³)	Thermal Output from Fuel Cell (kW·h)	Thermal Energy Withdrawn for Water Heating (kW·h)	Electrical Energy Output (kW)	Fuel Use (kW·h)	Average Air Flow Rate (kg/h)	Fuel Cell System Water Use (x 10 ⁻³ m ³)
	V _{wh}	Q _{fc} [*]	Q _{wh} [*]	\dot{E}_{wh}^*	F _{wh} [*]	$\dot{m}_{a,wh}^*$	V _w [*]
1	0.0406	3.38	1.84	1.54	11.58	319.4	0.74
2	0.0406	2.93	1.69	1.29	9.30	304.7	0.75
3	0.0406	2.62	1.74	1.08	8.77	298.6	0.99
4	0.0406	2.53	1.77	1.01	8.63	299.3	1.09
5	0.0406	2.51	1.79	0.99	8.61	297.6	1.11
6	0.0406	2.52	1.79	0.99	8.61	294.3	1.16
7	0	1.65	0.00	0.43	7.00	285.4	1.46
8	0	0.11	0.00	-0.76	1.16	314.0	0.23
9	0	0.65	0.00	-0.42	5.77	300.2	0.75
10	0	1.70	0.00	0.51	7.00	282.6	1.46
11	0	0.02	0.00	-0.82	1.09	310.5	0.18
12	0	0.60	0.00	-0.48	5.43	304.3	0.62
13	0	1.73	0.00	0.54	6.97	282.9	1.38
14	0	0.33	0.00	-0.59	1.72	311.1	0.47
15	0	0.04	0.00	-0.96	2.92	293.0	0.00
16	0	1.74	0.00	0.61	8.10	291.8	1.63
17	0	0.79	0.00	-0.25	3.51	301.2	0.90
18	0	-0.20	0.00	-0.92	1.37	307.0	0.00
19	0	1.51	0.00	0.21	7.86	299.5	1.21
20	0	1.57	0.00	0.34	6.60	300.9	1.52
21	0	-0.17	0.00	-0.92	1.35	310.7	0.05
22	0	0.34	0.00	-0.68	4.33	315.4	0.54
23	0	1.82	0.00	0.64	7.11	301.0	1.47
24	0	0.12	0.00	-0.74	0.80	317.7	0.30
Expanded Uncertainty (k=2)	0.0001	3.5 %	5.0 %	0.7 %	0.6 %	6.0 %	1.0 %

B.5 Energy Ratings

The simulated use data and part load functions can now be used to calculate the predicted annual thermal output, fuel use, electrical output, air flow, and water use, as described in section 10.4. The following text was taken directly from section 10.4.5.3 and shows Eqs. 10-129 through

10-145 with the result for the first hour of the winter representative day in Jacksonville, FL shown for example. The water heating requirement as well as the corresponding electrical energy output, fuel use, water use, and ventilation airflow quantity are determined from the hot water simulated use test as shown in Table B.4.

If the unit uses indoor ventilation air, the thermal energy that is required for heating the ventilation air associated with water heating, $\Delta Q_{a,wh,i}^*$, in kJ (Btu) is given by:

$$\begin{aligned}\Delta Q_{a,wh,i}^* &= \max[\dot{m}_{a,wh,i}^* \times 1 \text{ h} \times c_{pa} (T_{iah} - T_{oa}), 0] \\ &= \max[319.4 \text{ kg/h} \times 1 \text{ h} \times 1.004 \text{ kJ/kg} \cdot ^\circ\text{C} \times (21^\circ\text{C} - 9.41^\circ\text{C}), 0] \\ &= 4037 \text{ kJ} = 1.12 \text{ kWh}\end{aligned}\quad (10-129)$$

where:

c_{pa} is the constant pressure specific heat for air at assumed conditions of 5°C (40°F) which is $1.004 \text{ kJ/kg} \cdot ^\circ\text{C}$ ($0.240 \text{ Btu/lbm} \cdot ^\circ\text{F}$)

T_{oa} is the temperature of the outdoor air at hour i , $^\circ\text{C}$ ($^\circ\text{F}$)

T_{iah} is the temperature of the indoor air at heating conditions which is 21°C (70°F)

The thermal energy used for heating water and the associated ventilation air is subtracted from the rated RFCS thermal output, $Q_{fc,i}^*$, to determine a first approximation for the thermal energy available for space heating from the RFCS:

$$\begin{aligned}Q_{lav,i}^* &= Q_{fc,i}^* - Q_{wh,i}^* - \Delta Q_{a,wh,i}^* - Q_{loss,i}^* \\ &= 7.01 \text{ kWh} - 1.84 \text{ kWh} - 1.12 \text{ kWh} - 0.84 \text{ kWh} = 3.21 \text{ kWh}\end{aligned}\quad (10-130)$$

where the correction, $\Delta Q_{a,wh,i}^*$, is zero if the unit does not use indoor air for ventilation. A first approximation to the thermal output of an indoor Type III RFCS for space heating is the minimum of the available thermal energy and the space heating load:

$$Q_{lsh,i}^* = \min(Q_{lav,i}^*, Q_{LS,i}) = \min(3.21 \text{ kWh}, 0.939 \text{ kWh}) = 0.939 \text{ kWh}\quad (10-131)$$

This first approximation must be corrected to reflect the increase in thermal energy required by the residence due to heating ventilation air required by the RFCS as it supplies space heating. The quantity of air is determined by the first approximation to the thermal part-load ratio:

$$r_{lt,i} = \frac{Q_{lsh,i}^* + Q_{wh,i}^* + Q_{loss,i}^*}{\dot{Q}_{fc}^{R*} \times 1 \text{ hour}} = \frac{0.939 \text{ kWh} + 1.84 \text{ kWh} + 0.84 \text{ kWh}}{7.01 \text{ kWh}} = 0.516\quad (10-132)$$

The first approximation to the thermal part-load ratio is used in conjunction with the part-load ventilation air factor to determine the first approximation to the mass of ventilation air associated with space heating, $\dot{m}_{a,sh,i}^*$ in kg (lb_m):

$$\dot{m}_{a,sh,i}^* = Z_a^* (r_{lt,i}) \dot{m}_a^{R*} = 0.786 \times 0.106 \text{ kg/h} = 301 \text{ kg/h}\quad (10-133)$$

The thermal energy that is required for heating the ventilation air associated with space heating is, $\Delta Q_{a,sh,i}$, in kJ (Btu):

$$\begin{aligned}\Delta Q_{a,sh,i} &= \max[\dot{m}_{a,sh,i}^* \times 1 \text{ h} \times c_{pa} (T_{iah} - T_{oa}), 0] \\ &= \max[301 \text{ kg/h} \times 1 \text{ h} \times 1.004 \text{ kJ/kg} \cdot \text{K} \times (21^\circ\text{C} - 9.41^\circ\text{C}), 0] \\ &= 3805 \text{ kJ} = 1.06 \text{ kWh}\end{aligned}\quad (10-134)$$

The net thermal energy for space heating supplied by the RFCS is given by:

$$\begin{aligned}Q_{sh,i}^* &= \min[(\dot{Q}^R \times 1 \text{ h} - Q_{wh,i}^* - \Delta Q_{a,wh,i}^* - \Delta Q_{a,sh,i}^* - Q_{loss,i}^*) Q_{Ls,i}] \\ &= \min[(7.01 \text{ kWh} - 1.84 \text{ kWh} - 1.12 \text{ kWh} - 1.06 \text{ kWh} - 0.84 \text{ kWh}), 0.939 \text{ kWh}] \\ &= 0.939 \text{ kWh}\end{aligned}\quad (10-135)$$

There is likely some synergy associated with combining the water heating and space heating loads (e.g. less cycling of the system). However, the amounts of electricity produced, fuel used, and water used in the process of meeting the combined water heating and space heating requirements cannot be less than the amounts associated with water heating alone as reflected in the simulated use tests. Likewise, the amounts of electricity produced, fuel used, and water used in the process of meeting the combined water heating and space heating requirements cannot be less than the amounts associated with meeting the sum of the water heating and space heating loads while operating in steady state mode. Thus, the electrical output, E_i^* , in kWh, the fuel use, F_i^* in kWh (Btu), and the water use $V_{w,i}^*$, in L (gal) are each estimated as the maximum of the respective simulated use and steady values:

$$F_i^* = \max[F_{wh,i}^*, F_{ss,i}^*] \quad (10-136)$$

$$E_i^* = \max[E_{wh,i}^*, E_{ss,i}^*] \quad (10-137)$$

$$V_i^* = \max[V_{wh,i}^*, V_{ss,i}^*] \quad (10-138)$$

where variables associated with water heating are as previously defined and:

$E_{fc,ss,i}^*$ is the electrical energy produced if the RFCS operated in steady state mode to meet the combined water heating and space heating requirement, kWh

$F_{ss,i}^*$ is fuel used if the RFCS operated in steady state mode to meet the combined water heating and space heating requirement, kWh (Btu)

$V_{w,ss,i}^*$ is the water used if the RFCS operated in steady state mode to meet the combined water heating and space heating requirement, L (gal)

Values for the electricity produced, fuel used, and water used in conjunction with meeting the water heating requirement are determined directly from the simulated use test (Eqns. 10-108, 10-109, and 10-110). The remaining mass and energy flows for steady state operation to meet the combined space heating and water heating requirements ($E_{fc,ss,i}^*$, $F_{ss,i}^*$, $V_{w,ss,i}^*$) are based on the gross thermal energy output of the RFCS:

$$Q_{fc,i}^* = Q_{sh,i}^* + Q_{wh,i}^* + \Delta Q_{a,wh,i}^* + \Delta Q_{a,sh,i}^* + Q_{loss,i}^* \\ = 0.939 \text{ kWh} + 1.84 \text{ kWh} + 1.12 \text{ kWh} + 1.06 \text{ kWh} + 0.84 \text{ kWh} = 5.80 \text{ kWh} \quad (10-139)$$

This gross thermal output is used to determine a thermal part-load ratio:

$$r_{t,i}^* = \frac{Q_{fc,i}^*}{\dot{Q}^{R*} \times 1 \text{ h}} = \frac{5.80 \text{ kWh}}{7.01 \text{ kWh}} = 0.827 \quad (10-140)$$

For operation in a steady mode to meet both water heating and space heating requirements, the electrical energy output, fuel use, and water use are determined by this thermal part load ratio:

$$E_{fc,ss,i}^* = Z_e^*(r_{t,i}^*) \times \dot{E}^{R*} \times 1 \text{ h} = 0.836 \times 4.01 \text{ kWh} = 3.36 \text{ kWh} \quad (10-141)$$

$$F_{ss,i}^* = Z_f^*(r_{t,i}^*) \times \dot{F}^{R*} \times 1 \text{ h} = 0.873 \times 18.14 \text{ kWh} = 15.8 \text{ kWh} \quad (10-142)$$

$$V_{w,ss,i}^* = Z_w^*(r_{t,i}^*) \times \dot{V}_w^{R*} \times 1 \text{ h} = 0.0 \times 0.0 \text{ L/s} = 0.0 \text{ L/s} \quad (10-143)$$

The electrical energy that is used by the residence is the minimum of the electrical energy available from the fuel cell and the electrical energy requirement of the residence, $E_{L,i}$, in kWh:

$$E_i^* = \min[E_{fc,i}^*, E_{L,i}] = \min[3.36 \text{ kWh}; 0.2 \text{ kWh}] = 0.2 \text{ kWh} \quad (10-144)$$

The remaining power (if any), G_i^* , in kWh is supplied to the electrical grid:

$$G_i^* = E_{fc,i}^* - E_i^* = 3.36 \text{ kWh} - 0.2 \text{ kWh} = 3.16 \text{ kWh} \quad (10-145)$$

Using a similar procedure for each hour of the three representative days in Jacksonville, FL, the following cumulative/annual values are calculated.

Table B.5. Annual/Cumulative Predicted Values for Indoor Type III RFCS in Jacksonville, FL

Description	Equation	Value
Annual electrical energy supplied to the residence	$AE = 91 \times \sum_{i=1}^{24} E_i^A + 183 \times \sum_{i=1}^{24} E_i^B + 91 \times \sum_{i=1}^{24} E_i^C$	6,071 kW·h
Annual electrical energy supplied to the utility grid	$AG = 91 \times \sum_{i=1}^{24} G_i^A + 183 \times \sum_{i=1}^{24} G_i^B + 91 \times \sum_{i=1}^{24} G_i^C$	4,377 kW·h
Annual thermal energy delivered for water heating	$AQ_{wh} = 91 \times \sum_{i=1}^{24} Q_{wh,i}^A + 183 \times \sum_{i=1}^{24} Q_{wh,i}^B + 91 \times \sum_{i=1}^{24} Q_{wh,i}^C$	3,877 kW·h
Annual thermal energy delivered for space heating	$AQ_{sh} = 91 \times \sum_{i=1}^{24} Q_{sh,i}^A + 183 \times \sum_{i=1}^{24} Q_{sh,i}^B + 91 \times \sum_{i=1}^{24} Q_{sh,i}^C$	1,985 kW·h
Annual fuel energy consumed	$AF = 91 \times \sum_{i=1}^{24} F_i^A + 183 \times \sum_{i=1}^{24} F_i^B + 91 \times \sum_{i=1}^{24} F_i^C$	68,652 kW·h
Annual volume of domestic water supplied to the fuel cell system	$AW = 91 \times \sum_{i=1}^{24} V_{w,i}^A + 183 \times \sum_{i=1}^{24} V_{w,i}^B + 91 \times \sum_{i=1}^{24} V_{w,i}^C$	23,813 L